

Annual Environmental Report

2024



Summerhill

D0259-01

CONTENTS

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2024 AER

- 1.1 ANNUAL STATEMENT OF MEASURES
- 1.2 TREATMENT SUMMARY
- 1.3 ELV OVERVIEW
- 1.4 LICENSE SPECIFIC REPORT INCLUDED IN AER

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

- 2.1 SUMMERHILL WWTP - TREATED DISCHARGE
 - 2.1.1 INFLUENT SUMMARY - SUMMERHILL WWTP
 - 2.1.2 EFFLUENT MONITORING SUMMARY - SUMMERHILL WWTP
 - 2.1.3 AMBIENT MONITORING SUMMARY FOR THE TREATMENT PLANT DISCHARGE
 - 2.1.4 OPERATIONAL REPORTS SUMMARY FOR SUMMERHILL WWTP
 - 2.1.5 SLUDGE/OTHER INPUTS TO SUMMERHILL WWTP

3 COMPLAINTS AND INCIDENTS

- 3.1 COMPLAINTS SUMMARY
- 3.2 REPORTED INCIDENTS SUMMARY
 - 3.2.1 SUMMARY OF INCIDENTS
 - 3.2.2 SUMMARY OF OVERALL INCIDENTS

4 INFRASTRUCTURAL ASSESSMENT AND PROGRAMME OF IMPROVEMENTS

- 4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT
 - 4.1.1 SWO IDENTIFICATION AND INSPECTION SUMMARY REPORT
- 4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS
 - 4.2.1 SPECIFIED IMPROVEMENT PROGRAMME SUMMARY
 - 4.2.2 IMPROVEMENT PROGRAMME SUMMARY
 - 4.2.3 SEWER INTEGRITY RISK ASSESSMENT

5 LICENCE SPECIFIC REPORTS

- 5.1 PRIORITY SUBSTANCES ASSESSMENT
- 5.2 SMALL STREAM RISK SCORE ASSESSMENT

6 CERTIFICATION AND SIGN OFF

- 6.1 SUMMARY OF AER CONTENTS

7 APPENDIX

- 7.1 SMALL STREAM RISK SCORE ASSESSMENT

1 EXECUTIVE SUMMARY AND INTRODUCTION TO THE 2024 AER

This Annual Environmental Report has been prepared for D0259-01, Summerhill, in Meath in accordance with the requirements of the wastewater discharge licence for the agglomeration. Specified reports where relevant are included as an appendix to the AER.

1.1 ANNUAL STATEMENT OF MEASURES

A summary of any improvements undertaken is provided where applicable.

There were no capital works, significant changes or operational changes undertaken in 2024.

1.2 TREATMENT SUMMARY

The agglomeration is served by a wastewater treatment plant(s)

- Summerhill WWTP with a Plant Capacity PE of 3000, the treatment type is 3P - Tertiary P removal.

1.3 ELV OVERVIEW

The overall compliance of the final effluent with the Emission Limit Values (ELVs) is shown below. More detailed information on the below ELV's can be found in Section 2.

Discharge Point Reference	Treatment Plant	Discharge Type	Compliance Status	Parameters failing if relevant
TPEFF2300D0259SW001	Summerhill WWTP	Treated	Compliant	N/A

1.4 LICENCE SPECIFIC REPORTING

Assessment / Report
Small Stream Risk Score Assessment

2 TREATMENT PLANT PERFORMANCE AND IMPACT SUMMARY

2.1 SUMMERHILL WWTP - TREATED DISCHARGE

2.1.1 INFLUENT MONITORING SUMMARY - SUMMERHILL WWTP

A summary of influent monitoring for the treatment plant is presented below. This monitoring is primarily undertaken in order to determine the overall efficiency of the plant in removing pollutants from the raw wastewater.

Parameters	Number of Samples	Annual Max	Annual Mean
COD-Cr mg/l	12	1093	402
Total Phosphorus (as P) mg/l	12	10	4.61
Total Nitrogen mg/l	12	69	36
BOD, 5 days with Inhibition (Carbonaceous) mg/l	12	846	201
Suspended Solids mg/l	12	1066	192
Hydraulic Capacity	N/A	1109	354

If other inputs in the form of sludge / leachate are added to the WWTP then these are included in Section 2.1.5 if applicable.

Significance of Results:

The annual mean hydraulic loading is less than the peak Treatment Plant Capacity. The annual maximum hydraulic loading is less than the peak Treatment Plant Capacity. Further details on the plant capacity and efficiency can be found under the sectional 'Operational Performance Summary'. The design of the wastewater treatment plant allows for peak values and therefore the peak loads have not impacted on compliance with Emission Limit Values.

2.1.2 EFFLUENT MONITORING SUMMARY - TPEFF2300D0259SW001

Parameter	WWDL ELV (Schedule A)	ELV with Condition 2 Interpretation included Note 1	Interim % reduction from influent concentration	Number of sample results	Number of exceedances	Number of exceedances with Condition 2 Interpretation included	Annual Mean	Overall Compliance (Pass/Fail)
COD-Cr mg/l	125	250	N/A	12	N/A	N/A	9.61	Pass
Suspended Solids mg/l	35	87.5	N/A	12	N/A	N/A	5.06	Pass
pH pH units	6	9	N/A	12	N/A	N/A	7.59	Pass
BOD, 5 days with Inhibition (Carbonaceous) mg/l	5	10	N/A	12	N/A	N/A	1.19	Pass
Ammonia-Total (as N) mg/l	1	2	N/A	12	N/A	N/A	0.093	Pass
ortho-Phosphate (as P) - unspecified mg/l	0.5	0.6	N/A	12	N/A	N/A	0.073	Pass
Total Phosphorus (as P) mg/l	N/A	N/A	N/A	12	N/A	N/A	0.111	

Notes:

1 – This represents the Emission Limit Values after the Interpretation provided for under Condition 2 of the licence is applied

2 – For pH the WWDA specifies a range of pH 6 - 9

Cause of Exceedance(s):

Not applicable

Significance of Results:

The WWTP is compliant with the ELV's set in the Wastewater Discharge Licence.

2.1.3 AMBIENT MONITORING SUMMARY FOR THE TREATMENT PLANT DISCHARGE TPEFF2300D0259SW001

A summary of monitoring from ambient monitoring points associated with the wastewater discharge is provided in the sections below. For discharges to rivers upstream (U/S) and downstream (D/S) location data is provided. For other ambient points in lakes, coastal or transitional waters, monitoring data from the most appropriate monitoring station is selected.

The table below provides details of ambient monitoring locations and details of any designations as sensitive areas.

Ambient Monitoring Point from WWDL (or as agreed with EPA)	Irish Grid Reference	River Station Code	Bathing Water	Drinking Water	FWPM	Shellfish	WFD Ecological Status
Upstream	285788, 248965	RS07K020200	No	No	No	No	Poor
Downstream	283268, 250875	RS07K020300	No	No	No	No	Poor

The table below provides a summary of monitoring results for designated ambient monitoring points. The upstream and downstream annual mean values are shown (mg/l), and the difference between both monitoring stations is given as a percentage of the Environmental Quality Standard (EQS) where relevant.

Parameter Name	Upstream Monitoring Point Location	Upstream Monitoring Point Annual Mean	Downstream Monitoring Point Location	Downstream Monitoring Point Annual Mean	EQS	% of EQS
BOD - 5 days (Total) mg/l	RS07K020200	1.25	RS07K020300	0.894	1.50	-23.7

Parameter Name	Upstream Monitoring Point Location	Upstream Monitoring Point Annual Mean	Downstream Monitoring Point Location	Downstream Monitoring Point Annual Mean	EQS	% of EQS
Ammonia-Total (as N) mg/l	RS07K020200	0.032	RS07K020300	0.060	0.065	44.4
ortho-Phosphate (as P) - unspecified mg/l	RS07K020200	0.075	RS07K020300	0.072	0.035	-10.1
pH pH units	RS07K020200	8.03	RS07K020300	8.01	N/A	
Dissolved Oxygen % Saturation	RS07K020200	99	RS07K020300	93	N/A	
Total Nitrogen mg/l	RS07K020200	1.56	RS07K020300	2.08	N/A	
Dissolved Oxygen mg/l	RS07K020200	9.72	RS07K020300	9.82	N/A	

Significance of Results:

The WWTP discharge was compliant with the ELV's set in the wastewater discharge licence.

The ambient monitoring results do not meet the required EQS at the upstream and the downstream monitoring locations. The EQS relates to the Oxygenation and Nutrient Conditions set out in the Surface Water Regulations 2009.

Based on ambient monitoring results a deterioration in Ammonia concentrations downstream of the effluent discharge is noted.

A deterioration in water quality has been identified, however it is not known if it or is not caused by the WWTP.

As per the 3rd Cycle Boyne Catchment Report (HA 07), the significant pressure on the Knightbrook_020 waterbody is Agriculture.

The discharge from the wastewater treatment plant does not have an observable negative impact on the Water Framework Directive status.

2.1.4 OPERATIONAL PERFORMANCE SUMMARY - SUMMERHILL WWTP

2.1.4.1 Treatment Efficiency Report - Summerhill WWTP

Treatment efficiency is based on the removal of key pollutants from the influent wastewater by the treatment plant. In essence the calculation is based on the balance of load coming into the plant versus the load leaving the plant. The efficiency is presented as a percentage removal rate.

A summary presentation of the efficiency of the treatment process including information for all the parameters specified in the licence is included below:

Parameter	Influent mass loading (kg/year)	Effluent mass emission (kg/year)	Efficiency (% reduction of influent load)
COD	50452	1517	97
SS	24167	798	97
cBOD	25189	187	99
TP	579	18	97

Note: The above data is based on sample results for the number of dates reported

2.1.4.2 Treatment Capacity Report Summary - Summerhill WWTP

Treatment capacity is an assessment of the hydraulic (flow) and organic (the amount of pollutants) load a treatment plant is designed to treat versus the current loading of that plant.

Summerhill WWTP	
Peak Hydraulic Capacity (m³/day) - As Constructed	2025
DWF to the Treatment Plant (m³/day)	675
Current Hydraulic Loading - annual max (m³/day)	1109
Average Hydraulic loading to the Treatment Plant (m³/day)	354

3 COMPLAINTS AND INCIDENTS

3.1 COMPLAINTS SUMMARY

A summary of complaints of an environmental nature related to the discharge(s) to water from the WWTP and network is included below.

Number of Complaints	Nature of Complaint	Number Open Complaints	Number Closed Complaints
There were no relevant environmental complaints in 2024.			

3.2 REPORTED INCIDENTS SUMMARY

Environmental incidents that arise in an agglomeration are reported on an on-going basis in accordance with our waste water discharge licences. Where an incident occurs and it is reportable under the licence, it is reported to the Environmental Protection Agency through their Environmental Data Exchange Network, or in some instances by telephone. Some incidents which arise in the agglomeration are recorded by Uisce Éireann but may not be reportable under our licence for example where the incident does not have an impact on environmental performance.

A summary of reported incidents is included below.

3.2.1 SUMMARY OF INCIDENTS

Incident Type	Cause	Recurring (Y/N)	Closed (Y/N)
There were no reportable incidents in 2024.			

3.2.2 SUMMARY OF OVERALL INCIDENTS

Question	Answer
Number of Incidents in 2024	0
Number of Incidents reported to the EPA via EDEN in 2024	0
Explanation of any discrepancies between the two numbers above	N/A

4 INFRASTRUCTURAL ASSESSMENTS AND PROGRAMME OF IMPROVEMENTS

4.1 STORM WATER OVERFLOW IDENTIFICATION AND INSPECTION REPORT

A summary of the operation of the storm water overflows and their significance where known is included below:

4.1.1 SWO IDENTIFICATION

WWDL Name / Code for Storm Water Overflow (chamber) where applicable	Irish Grid Ref. (outfall)	Included in Schedule of the WWDL	Significance of the overflow(High / Medium / Low)	Assessed against DoEHLG Criteria	No. of times activated in 2024 (No. of events)	Total volume discharged in 2024 (m ³)	Monitoring Status
SW2	284910, 249401	Yes	Low Significance	Meeting Criteria	0	0	Monitored

The contents presented in this table include the most up to date information available at the time of writing. Any TBC SWO(s) were identified as part of the on-going National SWO programme and will be updated in subsequent AER(s) once the information is confirmed.

SWO Summary	
How much wastewater discharge by metered SWOs during the year (m ³)?	0
Is each SWO identified as not meeting DoEHLG Guidance included in the Programme of Improvements?	N/A
The SWO Assessment included the requirements of relevant of WWDL schedules?	Yes
Have the EPA been advised of any additional SWOs / changes to Schedule C3 and A4 under Condition 1.7?	N/A

4.2 REPORT ON PROGRESS MADE AND PROPOSALS BEING DEVELOPED TO MEET THE IMPROVEMENT PROGRAMME REQUIREMENTS

4.2.1 SPECIFIED IMPROVEMENT PROGRAMME SUMMARY

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Specified Improvement Programmes (under Schedule A and C of WWDL)	Description	Licence Schedule	Licence Completion Date	Date Expired? (N/NA/Y)	Status of Works	Timeframe for Completing the Work	Comments
D0259-SIP:01	Assessment of the options to reduce the impact of the primary discharge on the Cloneymeath River in accordance with Condition 5.2(d)	C	28/02/2013	Yes	Not Started		

A summary of the status of any other improvements identified by under Condition 5 assessments- is included below.

4.2.2 IMPROVEMENT PROGRAMME SUMMARY

Improvement Identifier	Improvement Description / or any Operational Improvements	Improvement Source	Expected Completion Date	Comments
No additional improvements planned at this time.				

4.2.3 SEWER INTEGRITY RISK ASSESSMENT

The utilisation of multiple capital maintenance programmes and the outputs of the workshops with the Local Authority Operations Staff held under the programme can be used to satisfy the requirements of Condition 5 regarding network integrity. Improvement works identified by way of these programmes and workshops will be included in the Improvements Summary Tables 4.2.1 and 4.2.2.

5 LICENCE SPECIFIC REPORTS

A wastewater discharge licence may require a number of reports on specific subject areas to be prepared for the agglomeration in question. These reports are submitted to the EPA as part of the Annual Environmental Report. This section provides a list of the various reports required for this agglomeration and a brief summary of their recommendations.

Licence Specific Report	Required by licence	Included in this AER
D0259-01-Priority Substances Assessment	Yes	No
D0259-01-Small Stream Risk Score Assessment	Yes	Yes

6 CERTIFICATION AND SIGN OFF

6.1 SUMMARY OF AER CONTENTS

Parameter	Answer
Does the AER include an Executive Summary?	Yes
Does the AER include an assessment of the performance of the Waste Water Works (i.e. have the results of assessments been interpreted against WWDL requirements and or Environmental Quality Standards)?	Yes
Is there a need to advise the EPA for Consideration of a Technical Amendment/Review of the Licence?	No
List reason e.g. additional SWO identified	N/A
Is there a need to request/advise the EPA of any modification to the existing WWDL with respect to condition 4 changes to monitoring location, frequency etc	Yes
List reason e.g. changes to monitoring requirements	Ambient Monitoring Location Changes
Have these processes commenced?	No
Are all outstanding reports and assessments from previous AERs included as an appendix to this AER	Yes

I certify that the information given in this Annual Environmental Report is truthful, accurate and complete:

Date: 26/04/2025

This AER has been produced by Uisce Éireann's Environmental Information System (EIMS) and has been electronically signed off in that system for and on behalf of,

Eleanor Roche

Head of Environmental Regulation.

7 APPENDIX

Appendix


Appendix 7.1 - Small Stream Risk Score Assessment



Summerhill, Co. Meath: Small-Streams Risk Score (SSRS)

Report for
Meath County Council

September 2024

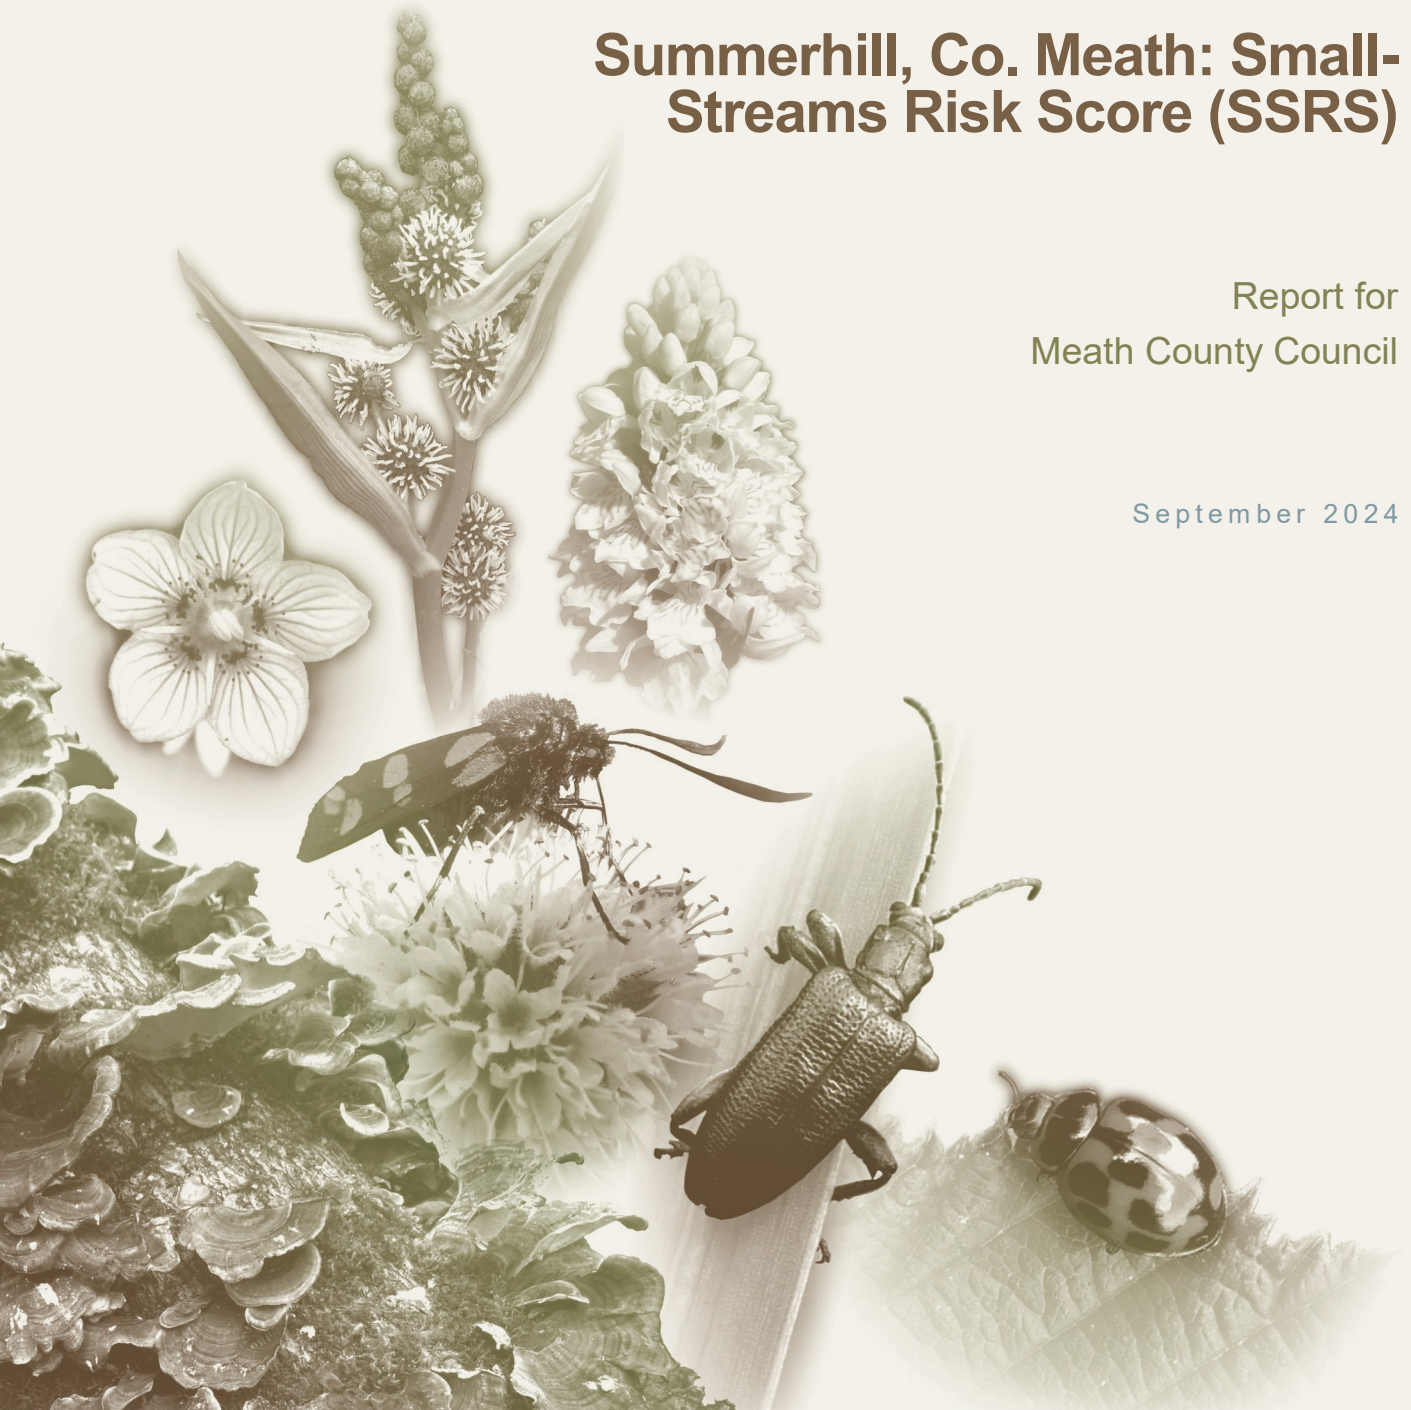

John T. Brophy

Summerhill, Co. Meath: Small-Streams Risk Score (SSRS)

Report prepared for:

Meath County Council,
Buvinda House, Dublin Road
Navan,
Co. Meath.

September 2024



Botanical, Environmental & Conservation Consultants Ltd.

65 Holywell, Dundrum, Dublin 14

Website: www.botanicaenvironmental.com

Email: info@botanicaenvironmental.com



DOCUMENT CONTROL SHEET

Client	Meath County Council
Project title	Summerhill SSRS 2024
Project number	PRJ359
Document title	Summerhill Small-Streams Risk Score (SSRS)
Citation	Brophy, J.T. (2024) Summerhill Small-Streams Risk Score (SSRS). Unpublished Report by BEC Consultants Ltd.

Author(s)	Reviewed by	Approved by	Version	Issue date
John T. Brophy B.A., M.Sc., MCIEEM, CEcol.	Jim Martin, Ph.D., MCIEEM	Jim Martin, Ph.D., MCIEEM	V1.0	26/09/2024

Table of Contents

1	Background.....	1
2	Methods	1
3	Results	1
4	Conclusion	2
5	References.....	2
	Appendix I – Score sheets	3

1 Background

BEC Consultants Ltd was contracted to carry out macroinvertebrate sampling on the Cloneymeath River and calculate a Small-Streams Risk Score (SSRS) for two samples taken upstream and downstream of Summerhill Waste Water Works, Summerhill, Co. Meath.

2 Methods

Two samples were taken on the Cloneymeath River, one upstream (u/s) and one downstream (d/s) of the Summerhill Waste Water Works discharge location by John Brophy of BEC Consultants, who is an EPA-registered SSRS assessor, on 25 September 2024 following the SSRS field methodology (Anon., 2009). The samples were taken using a standard hand-net and the SSRS calculated following the methods set out in the 'Small Streams Risk Score (SSRS) Training Manual' (Anon., 2009).

3 Results

The SSRS groups and taxa recorded from the upstream (u/s) and downstream (d/s) sample stations, with their relative abundances, are presented in Table 1 and Table 2, respectively. Group 1 taxa were only recorded at the d/s sample station. No Group 2 taxa were recorded at either sample station.

Table 1. SSRS groups and taxa from the upstream (u/s) sample station on the Cloneymeath River, Summerhill, Co. Meath taken on 25 September 2024.

Group	Taxon	Relative abundance (1-5)
Group 1 Ephemeroptera	-	-
Group 2 Plecoptera	-	-
Group 3 Trichoptera	Sericostomatidae	1
Group 4 G.O.L.D.	Potamopyrgus	1
	Tubificidae	1
	Chironomidae	2
	Chironomus	1
	Ceratopogonidae	1
Group 5 Asellus	<i>Asellus</i>	Common/Numerous

Table 2. SSRS groups and taxa from the downstream (d/s) sample station on the Cloneymeath River, Summerhill, Co. Meath on 25 September 2024.

Group	Taxon	Relative abundance (1-5)
Group 1 Ephemeroptera	Ephemerella	1
Group 2 Plecoptera	-	-
Group 3 Trichoptera	Hydropsychidae	2
	Polycentropodidae	1
	<i>Rhyacophila</i>	1
	Sericostomatidae	1
Group 4 G.O.L.D.	Potamopyrgus	1
	Tubificidae	1
	Simuliidae	2

	Dicranota	1
	Tipulidae	1
Group 5 Asellus	<i>Asellus</i>	Few/Low

The SSRS for each sample station was calculated following the methods of Anon. (2009) and the results are presented in Table 3.

Table 3. The Small-Streams Risk Score for two sample stations on the Cloneymeath River, Summerhill, Co. Meath on 25 September 2024.

Sample station	SSRS	Category
Upstream (u/s)	2.4	At risk
Downstream (d/s)	5.6	At risk

The SSRS scoresheets for sites u/s and d/s are presented in Appendix I, with photographs presented in Appendix II.

4 Conclusion

The SSRS for the upstream station (U/S) was 2.4, while that for the downstream station (D/S) was 5.6. Therefore, despite the difference in the scores, the Cloneymeath River, at both upstream and downstream locations, is 'At risk' of not meeting 'Good' status under the Water Framework Directive (2000/60/EC).

5 References

Anonymous (2009). Small Streams Risk Score (SSRS) Training Manual: A Pollution Investigation Tool for Use in the Field. Prepared on behalf of the Department of the Environment, Heritage and Local Government, Environmental Protection Agency and Water Services National Training Group (wsntg). (February 2020).

Appendix I – Score sheets

River: <u>CLONEYMEATH</u>		Code: <u>07K02</u>		Date: <u>25/09/2024</u>	Time: <u>10:30</u>
Station no. <u>u/s</u>		Location: <u>SUMMERHILL</u>		Grid (6 figure): <u>N857489</u>	
Stream Order: <u>2</u>		Stream flow: Riffle Riffle/Glide <u>Slow flow</u>			
Field Chemistry		Modifications: <input checked="" type="checkbox"/> N Canalised-widened-bank erosion-			
DO%	<u>92</u>	Arterial drainage			
DO mg/l	<u>8.3</u>	Dominant types:			
Temp (°C)	<u>9.6</u>	Bedrock			
Conductivity	<u>724 µS/cm</u>	Boulder (>128mm)			
pH	<u>8.01</u>	Cobble (32-128mm)			
Bank width (cm)	<u>470</u>	Gravel (8-32mm)			
Wet width (cm)	<u>305</u>	Fine Gravel (2-8mm)			
Avg Depth (cm)	<u>15</u>	Sand (0.25-2mm)			
Staff gauge	<u>0.8</u>	Silt (<0.25mm)			
Velocity	<u>Colour</u>	Slope: <u>Low</u> - Medium - High - Very High			
Torrential	<u>None</u>	Geology: <u>Calcareous</u> Siliceous-Mixed			
Fast	<u>Slight</u>	Substratum Condition: Calcareous-Compacted-			
Moderate	<u>Moderate</u>	Loose - <u>Normal</u>			
Slow	<u>High</u>	Substratum:			
<u>Very slow</u>		Stoney bottom-Muddy bottom <u>Mud over stones</u>			
Clarity	<u>Discharge</u>	Degree of siltation: Clean-Slight-Moderate- <u>Heavy</u>			
Very clear	<u>Flood</u>	Depth of mud: None: <1cm: <u>1-5cm</u> 5-10cm: >10cm			
<u>Clear</u>	<u>Normal</u>	Litter: <u>None</u> - Present - Moderate - Abundant			
Slightly turbid	<u>Low</u>	Filamentous Algae:			
Highly turbid	<u>Very Low</u>	<u>None</u> - Present - Moderate - Abundant			
	<u>Dry</u>	Main land use u/s:			
	<u>Recent Flood</u>	Pasture Urban Tillage Other			
		Sample retained: <u>Y</u> <u>N</u>			
		Sewage Fungus:			
		<u>None</u> - Present - Moderate - Abundant			
		Sampled in Minutes:			
		Pond net x <u>2</u>			
		Stone wash x <u>1</u>			
		Weed sweep x <u>-</u>			
General Comments:					
<u>OTTER SPANNT UNDER BRIDGE</u>					
Macroinvertebrate Composition					
The macroinvertebrates are divided into the following 5 specific groups:					
<ul style="list-style-type: none"> Group 1 = Ephemeroptera (3-tails) - note that tails may be damaged during sampling Group 2 = Plecoptera (2-tails) - note that tails may be damaged during sampling Group 3 = Trichoptera Group 4 = G.O.L.D. (Gastropoda, Oligochaeta and Diptera) Group 5 = Asellus 					
Calculate the total number of taxa and relative abundance of each macroinvertebrate group below: (Abundance - Ab)					
Ephemeroptera:		Plecoptera:		Relative Abundance	
Ecdyonurus Ab		Leuctra Ab		1-5 1	
Rhithrogena Ab		Isoperla Ab		6-20 2	
Heptagenia Ab		Protonemura Ab		21-50 3	
Ephemerella Ab		Amphinemura Ab		51-100 4	
Caenis Ab		Perla Ab		101+ 5	
Paraleptophlebia Ab		Dinocras Ab			
Ephemera danica Ab		Other Plecop Ab			
Other Ephem Ab		Other Plecop Ab			
Total no. of taxa	0	Total Relative Abundance	0	Total no. of Taxa	0
Trichoptera:		G.O.L.D.:		Total Relative Abundance	
Hydropsychidae Ab		Lymnaea (G) Ab		Chironomidae (D) Ab <u>2</u> Asellus	
Polycentropodidae Ab		Potamopyrgus (G) Ab		Chironomus (D) Ab	
Rhyacophila Ab		Planorbis (G) Ab		Simuliidae (D) Ab	
Philopotamidae Ab		Ancylus (G) Ab		Dicranota (D) Ab	
Limnephilidae Ab		Physa (G) Ab		Tipulidae (D) Ab	
Sericostomatidae Ab		Lumbriculus (Ol) Ab		Ceratopogonidae (D) Ab	
Glossosomatidae Ab		Eiseniella (Ol) Ab		Other GOLD Ab	
Lepidostomatidae Ab		Tubificidae (Ol) Ab			
Other Trichoptera Ab					
Total no. of Taxa	1	Total Relative Abundance	1	Total no. of Taxa	5
				Total Relative Abundance	
				6	
NOTE: Asellus must be recorded as absent if none are found					
NOTE: Baetis is an Ephemeropteran and is the most commonly occurring invertebrate genus in streams in Ireland. It is vital that Baetis is not counted in SSRS. See Appendix B for more details on how to identify Baetis.					

Figure A1: SSRS score sheet page 1 at upstream (u/s) site on the Cloneymeath River, Summerhill, Co. Meath.

Step 1. Calculate the Index Score by circling the appropriate box representing the total number of taxa and the total abundance calculated from **each macroinvertebrate group** calculated from page 1 of the recording sheet and enter in to the boxes in Step 2.

Group 1 - 3 Tails
Ephemeroptera

No. of taxa

Relative Abundance

Score

0 (circled) 1 2+

1-2 3+ 2 3+

4 6 4 8

Group 2 - 2 Tails
Plecoptera

No. of taxa

Relative Abundance

Score

0 (circled) 1 2+

1-2 3+ 2 3+

4 6 6 8

Group 3
Trichoptera

No. of taxa

Relative Abundance

Score

0 1-2 3+

1-2 3+ 3+

0 2 4 4

Group 4
G.O.L.D.

No. of taxa

Relative Abundance

Score

0 1-2 3+

1-2 3-6 7+ 3-6 7+

4 2 0 4 0

Group 5
Asellus

No. of taxa

Absent Few (1-20) Common (>20) (circled)

4 2 0

Step 2

a) Index Score Group 1 0 (circled)

b) Index Score Group 2 0 (circled)

c) Index Score Group 3 2 (circled)

d) Index Score Group 4 4 (circled)

e) Index Score Group 5 0 (circled)

Step 3. Calculate the Total Index Score, the Average Index Score and the SSR Score using the boxes below

Total Index Score (TIS) sum (a+b+c+d+e) **6** Average Index Score (AIS) TIS/5 (5 for 5 groups) **1.2** SSR Score (AIS x 2) **2.4**

Step 4. Assess the stream by comparing the final SSR score with the categories below and tick the appropriate box

> 7.25 Probably not at risk ☐ > 6.5 – 7.25 Indeterminate Stream may be at risk ☐ < 6.5 Stream at risk ☒

Surveyor (signed): [Signature] Name (print): John B. Kelly Date: 25 / 09 / 2024

Figure A2: SSRS score sheet page 2 at upstream (u/s) site on the Cloneymeth River, Summerhill, Co. Meath.

River: <u>Clonameath</u>		Code: <u>07K02</u>	Date: <u>25/09/2024</u>	Time: <u>11:35</u>
Station no. <u>D/S</u>		Location: <u>SUMMERHILL</u>		Grid (6 figure): <u>N832508</u>
Stream Order: <u>3</u>		Stream flow: <u>Riffle</u>		
Field Chemistry		Modifications: Y/N Canalised-widened <u>bank erosion</u>		
DO%	<u>95</u>	Dominant Types:		
DO mg/l	<u>9</u>	Bedrock		
Temp (°C)	<u>10.1</u>	<u>Boulder (>128mm)</u>		
Conductivity	<u>809 µS/cm</u>	<u>Cobble (32-128mm)</u>		
pH	<u>7.98</u>	<u>Gravel (8-32mm)</u>		
Bank width (cm)	<u>600</u>	<u>Fine Gravel (2-8mm)</u>		
Wet width (cm)	<u>310</u>	<u>Sand (0.25-2mm)</u>		
Avg Depth (cm)	<u>20</u>	<u>Silt (<0.25mm)</u>		
Staff gauge	<u>N/A</u>	Slope: <u>Low</u> - Medium - High - Very High		
Velocity	<u>None</u>	Geology: <u>Calcareous</u> Siliceous-Mixed		
Torrential	<u>None</u>	Substratum Condition: <u>Calcareous-Compacted</u>		
Fast	<u>Slight</u>	Loose <u>Normal</u>		
Moderate	<u>Moderate</u>	Substratum:		
Slow	<u>High</u>	Stony bottom-Muddy bottom <u>Mud over stones</u>		
Very slow	<u>Discharge</u>	Degree of siltation: <u>Clean-Slight-Moderate-Heavy</u>		
Clarity	<u>Flood</u>	Depth of mud: None: <1cm: 1-5cm: 5-10cm: >10cm		
Very clear	<u>Normal</u>	Litter: <u>None</u> - Present - Moderate - Abundant		
Clear	<u>Low</u>	Filamentous Algae:		
Slightly turbid	<u>Very Low</u>	None - Present - Moderate - Abundant		
Highly turbid	<u>Dry</u>	Main land use u/s:		
	<u>Recent Flood</u>	<u>Pasture</u> Urban Tillage Other		
		Sample retained: Y <u>N</u>		
		Sewage Fungus: <u>None</u> - Present - Moderate - Abundant		
		Sampled in Minutes:		
		Pond net x <u>2</u>		
		Stone wash x <u>1</u>		
		Weed sweep x <u>-</u>		
General Comments:				
Macroinvertebrate Composition				
The macroinvertebrates are divided into the following 5 specific groups:				
<ul style="list-style-type: none"> Group 1 = Ephemeroptera (3-tails) - note that tails may be damaged during sampling Group 2 = Plecoptera (2-tails) - note that tails may be damaged during sampling Group 3 = Trichoptera Group 4 = G.O.L.D (Gastropoda, Oligochaeta and Diptera) Group 5 = Asellus 				
Calculate the total number of taxa and relative abundance of each macroinvertebrate group below: (Abundance - Ab)				
Ephemeroptera:		Plecoptera:		Relative Abundance
<u>Ecdyonurus</u> Ab		<u>Leuctra</u> Ab		1-5 1
<u>Rhythrogena</u> Ab		<u>Isoperla</u> Ab		6-20 2
<u>Heptagenia</u> Ab		<u>Protonemura</u> Ab		21-50 3
<u>Ephemerella</u> Ab <u>1</u>		<u>Amphinemura</u> Ab		51-100 4
<u>Caenis</u> Ab		<u>Perla</u> Ab		101+ 5
<u>Paraleptophlebia</u> Ab		<u>Dinocras</u> Ab		
<u>Ephemera danica</u> Ab		<u>Other Plecop</u> Ab		
<u>Other Ephem</u> Ab		<u>Other Plecop</u> Ab		
Total no. of taxa	<u>1</u>	Total Relative Abundance	<u>1</u>	
Trichoptera:		G.O.L.D:		
<u>Hydropsychidae</u> Ab <u>2</u>		<u>Lymnaea</u> (G) Ab		
<u>Polycentropodidae</u> Ab <u>1</u>		<u>Potamopyrgus</u> (G) Ab <u>1</u>		
<u>Rhyacophila</u> Ab		<u>Planorbis</u> (G) Ab		
<u>Philopotamidae</u> Ab		<u>Ancylus</u> (G) Ab		
<u>Limnephilidae</u> Ab		<u>Physa</u> (G) Ab		
<u>Sericostomatidae</u> Ab <u>1</u>		<u>Lumbriculus</u> (O) Ab		
<u>Glossosomatidae</u> Ab		<u>Eiseniella</u> (O) Ab		
<u>Lepidostomatidae</u> Ab		<u>Tubificidae</u> (O) Ab <u>1</u>		
<u>Other Trichoptera</u> Ab				
Total no. of Taxa	<u>4</u>	Total Relative Abundance	<u>5</u>	
		Total no. of Taxa		<u>5</u>
		Total Relative Abundance		<u>6</u>
		Chironomidae (D) Ab		
		<u>Chironomus</u> (D) Ab		
		<u>Simuliidae</u> (D) Ab <u>2</u>		
		<u>Dicranota</u> (D) Ab <u>1</u>		
		<u>Tipulidae</u> (D) Ab <u>1</u>		
		<u>Ceratopogonidae</u> (D) Ab		
		<u>Other GOLD</u> Ab		
		Asellus		
		<u>Absent</u>		
		<u>Few/Low</u>		<u>✓</u>
		<u>Common/Numerous</u>		
NOTE: Asellus must be recorded as absent if none are found				

NOTE *Baetis* is an Ephemeropteran and is the most commonly occurring invertebrate genus in streams in Ireland. It is vital that *Baetis* is not counted in SSRS. See Appendix B for more details on how to identify *Baetis*.

Figure A3: SSRS score sheet page 1 at downstream (d/s) site on the Clonameath River, Summerhill, Co. Meath.

Step 1. Calculate the Index Score by circling the appropriate box representing the total number of taxa and the total abundance calculated from *each macroinvertebrate group* calculated from page 1 of the recording sheet and enter in to the boxes in Step 2.

Group 1 - 3 Tails
Ephemeroptera

No. of taxa: 0, 1, 2+

Relative Abundance: 0, 1-2, 3+, 2, 3+

Score: 0, 4, 6, 4, 8

Group 2 - 2 Tails
Plecoptera

No. of taxa: 0, 1, 2+

Relative Abundance: 0, 1-2, 3+, 2, 3+

Score: 0, 4, 6, 6, 8

Group 3
Trichoptera

No. of taxa: 0, 1-2, 3+

Relative Abundance: 0, 1-2, 3+, 3+

Score: 0, 2, 4, 4

Group 4
G.O.L.D

No. of taxa: 0, 1-2, 3+

Relative Abundance: 0, 1-2, 3-6, 7+, 3-6, 7+

Score: 0, 4, 2, 0, 4, 0

Group 5
Asellus

No. of taxa: Absent, Few (1-20), Common (>20)

Score: 4, 2, 0

Step 2

a) Index Score Group 1	4
b) Index Score Group 2	0
c) Index Score Group 3	4
d) Index Score Group 4	4
e) Index Score Group 5	2

Step 3. Calculate the Total Index Score, the Average Index Score and the SSR Score using the boxes below

Total Index Score (TIS)
sum (a+b+c+d+e) **14**

Average Index Score (AIS)
TIS/5 (5 for 5 groups) **2.8**

SSR Score
(AIS x 2) **5.6**

Step 4. Assess the stream by comparing the final SSR score with the categories below and tick the appropriate box

> 7.25
Probably not at risk ☐

> 6.5 – 7.25
Indeterminate
Stream may be at risk ☐

< 6.5
Stream at risk ☒

Surveyor (signed): John Blevy Name (print): John Blevy Date: 25 / 09 / 2024

Figure A4: SSRS score sheet page 2 at downstream (d/s) site on the Cloneymeth River, Summerhill, Co. Meath.



BEC Consultants Ltd.

65 Holywell, Dundrum,
Dublin 14, D14 P5W0

Email: info@botanicalenvironmental.com

Web: www.botanicalenvironmental.com

