

**WATER SERVICES ACT 2007 (AS AMENDED) — SECTION 56(16)**

**ORDER MADE BY UISCE ÉIREANN UNDER AND PURSUANT TO SECTION 56 (16) OF THE  
WATER SERVICES ACT 2007 (AS AMENDED)**

Uisce Éireann, being of the opinion that a serious deficiency of water available for distribution is likely to exist in County Tipperary, County Waterford, County Wexford and County Cork (excluding Cork City), (as shown in the maps in Appendix 1, Appendix 2, Appendix 3 and Appendix 4 to this Order) **HEREBY ORDERS** under and pursuant to Section 56(16) of the Water Services Act 2007 (as amended) that, for the specified period set out below and in the areas set out above, the use of water supplied by Uisce Éireann for all of the classes of use set in Column 1 below is prohibited for the period of seven and a half weeks up until Tuesday, 16<sup>th</sup> of September 2025. Should the prevailing weather conditions and a likely or actual serious deficiency of water available for distribution continue to persist, it may be necessary to further extend this prohibition period for an additional specified period, by way of a further order pursuant to the Water Services Act 2007 (as amended).

<b>COLUMN 1</b>	<b>COLUMN 2</b>
<b>PROHIBITED USE</b>	<b>SPECIFIED PERIOD</b>
<b>Use of water drawn through a hosepipe or similar apparatus for the purpose of –</b> <ul style="list-style-type: none"><li>i. watering a ‘garden’;</li><li>ii. cleaning a private motor-vehicle using a hosepipe</li><li>iii. cleaning a private leisure boat using a hosepipe</li><li>iv. filling or maintaining a domestic swimming or paddling pool (<b>except when using hand-held containers filled directly from a tap</b>)</li><li>v. filling or maintaining a domestic pond (<b>excluding fishponds</b>) using a hosepipe.</li><li>vi. filling or maintaining an ornamental fountain (<b>with the exception of such use for commercial purposes</b>).</li><li>vii. Use of water for filling or replenishing a swimming pool, artificial pond, lake or similar application.</li></ul>	<b>From 23:59 on Saturday, 26<sup>th</sup> July 2025 until 23.59 on Tuesday 16<sup>th</sup> September 2025</b>

**Specified Period:** This Order takes effect at 23.59 on Saturday, 26<sup>th</sup> July, and ceases to have effect at 23:59 on Tuesday 16<sup>th</sup> September subject to the potential necessity for a further

period of prohibition and / or restriction to be extended, depending on prevailing weather conditions. This order may be lifted before the specified period if possible, having regard to the prevailing weather conditions and the availability of water for distribution. Equally, it may be necessary to extend the specified period in time and to other water users, by way of additional order, should the prevailing conditions persist.

A copy of this Order may be seen at Uisce Éireann's registered office at Colvill House, 24-26 Talbot Street, Dublin 1 or is available on its website at <https://www.water.ie/>

A PERSON WHO CONTRAVENES THIS ORDER COMMITS AN OFFENCE PURSUANT TO SECTION 56(18) OF THE WATER SERVICES ACT 2007 (AS AMENDED), AND IS LIABLE ON SUMMARY CONVICTION TO A FINE NOT EXCEEDING €5,000.

Dated: 21 July 2025

Signed: .....




Signed: .....



**Appendix 4 to Uisce Éireann Order dated 21 July 2025**

**County Cork (excluding Cork City)**

**The areas shown in purple are the areas to which this Order applies**

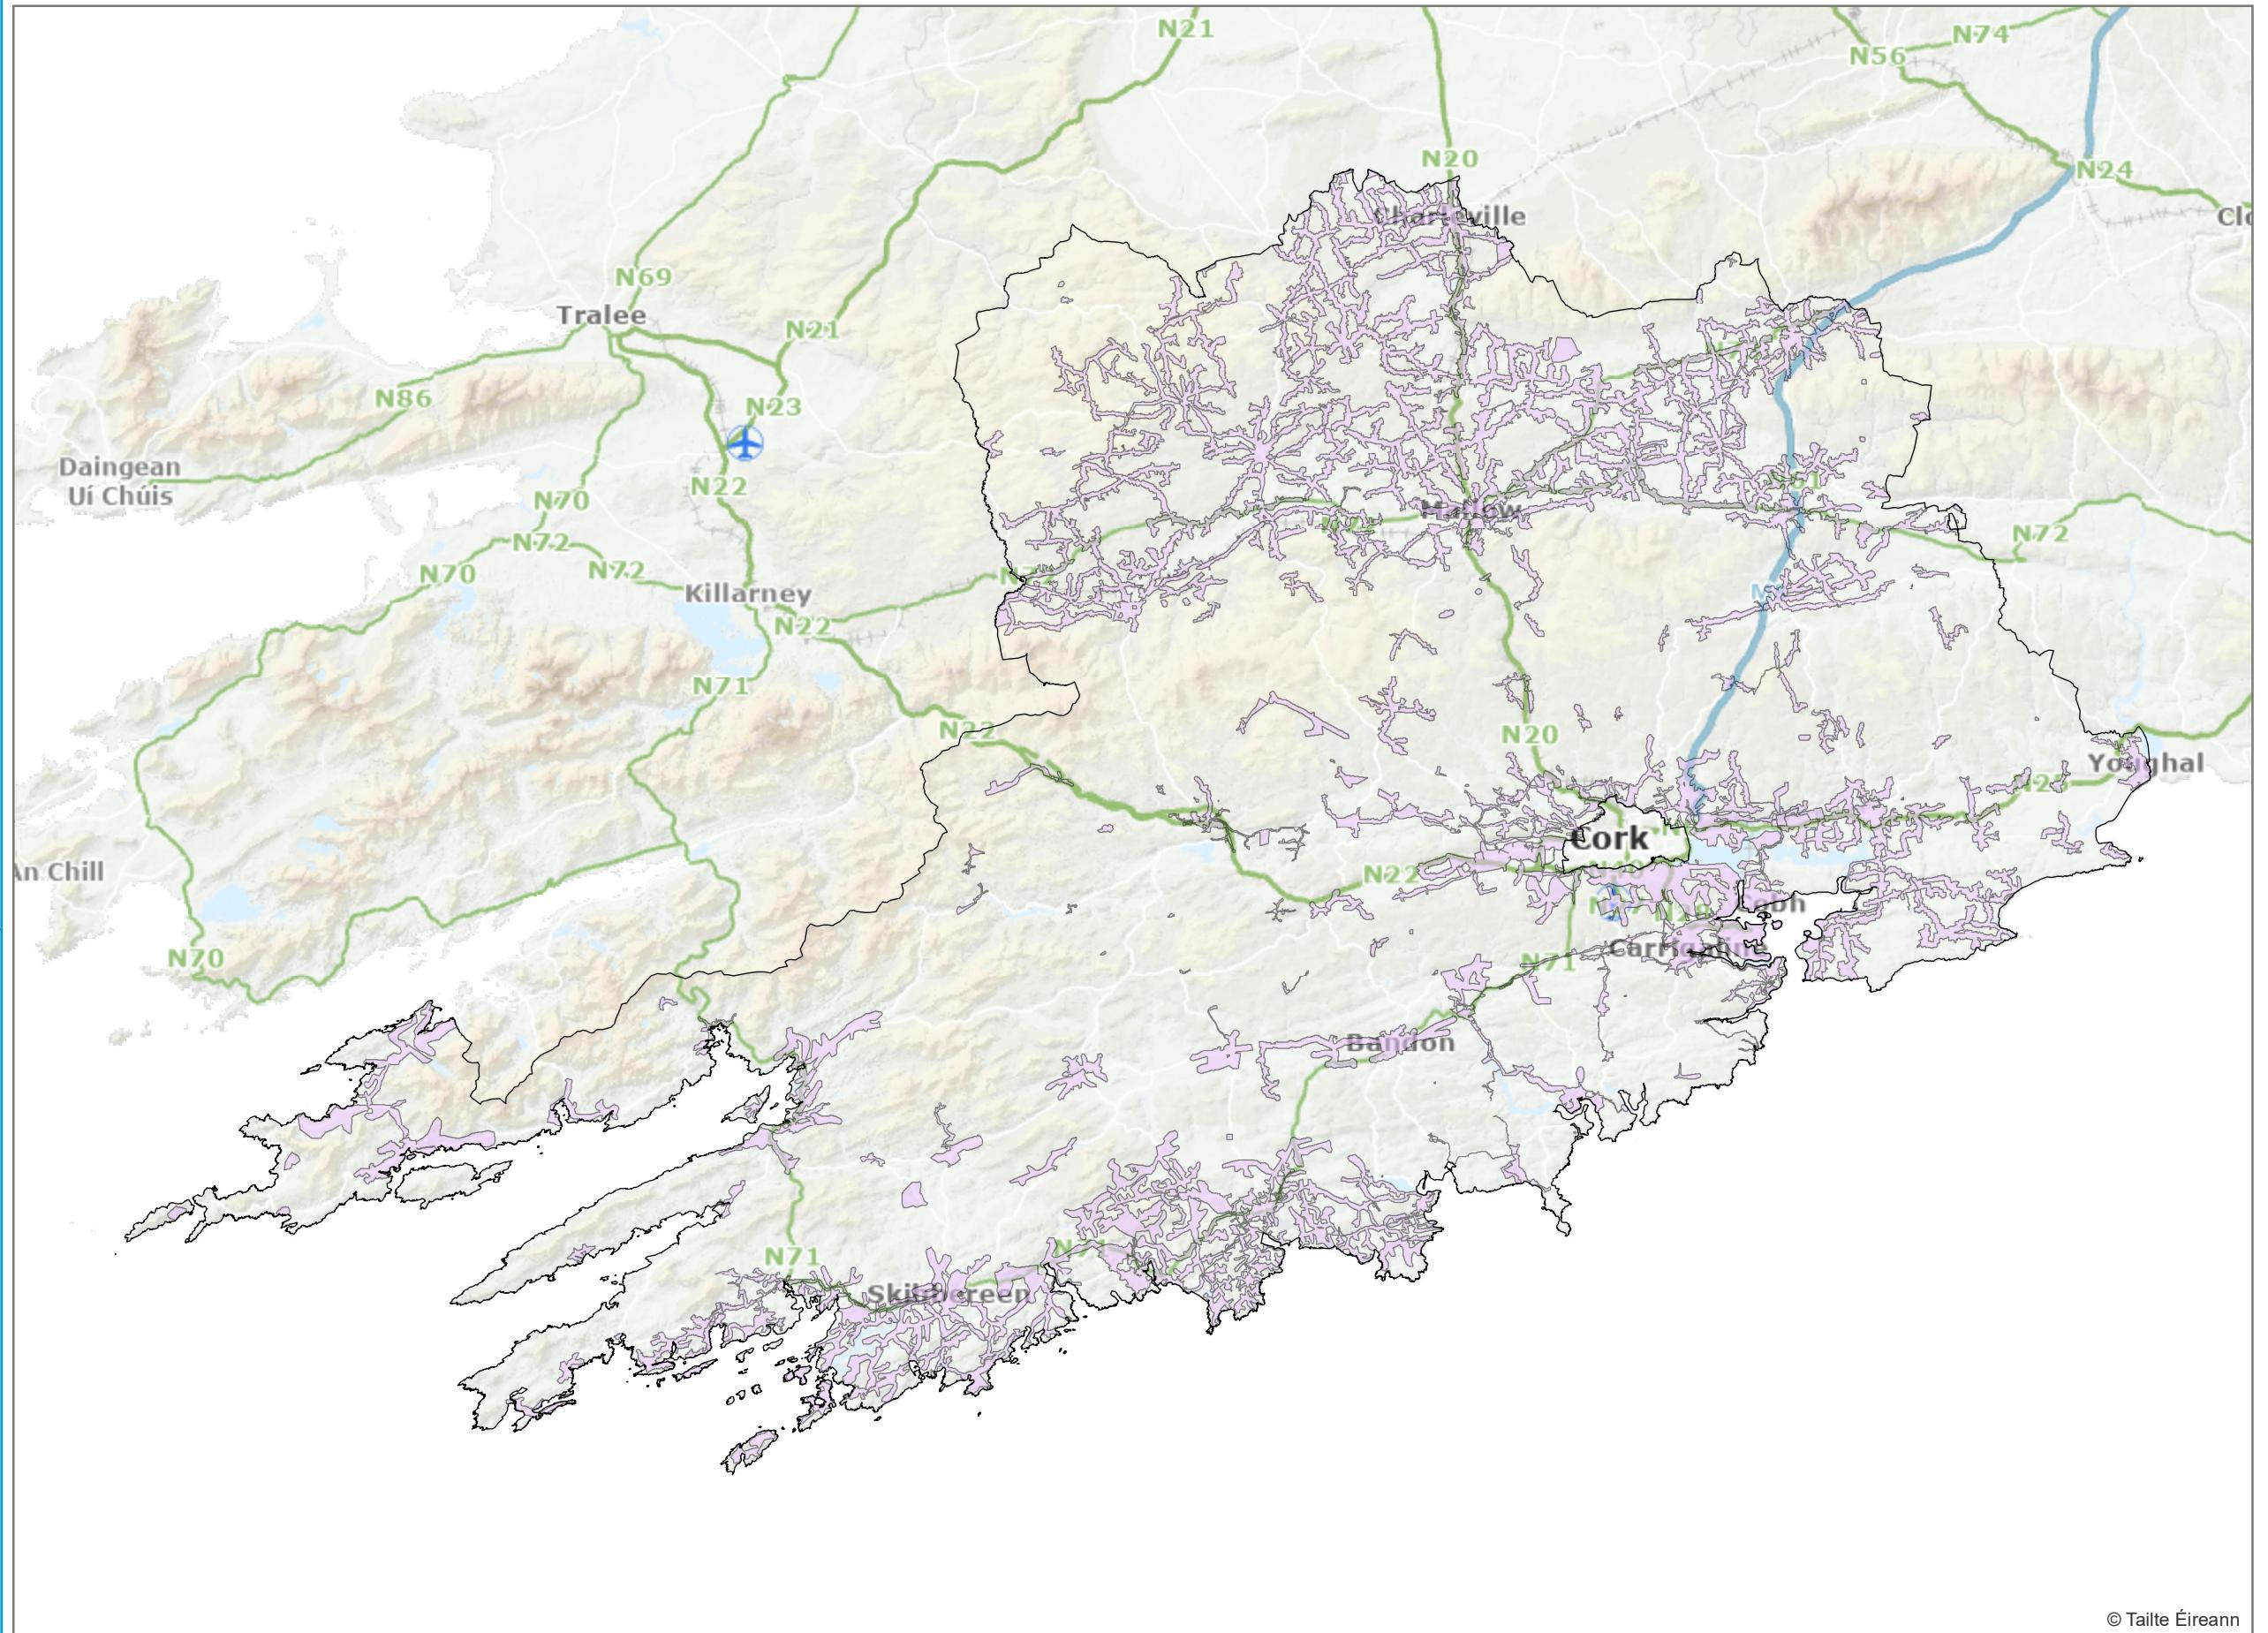

#### Legend

 Cork WRZ

 Kilometers  
01 5 6 9 12

Coordinate System: TM75 Irish Grid  
Projection: Transverse Mercator

Scale @ A3: 1:546,951

Drawn Date 16/07/2025





1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Irish Water as copyright holder except as agreed for use on the project for which the document was originally issued.

2. Whilst every care has been taken in its compilation, Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Irish Water

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

## Cork Water Resource Zones

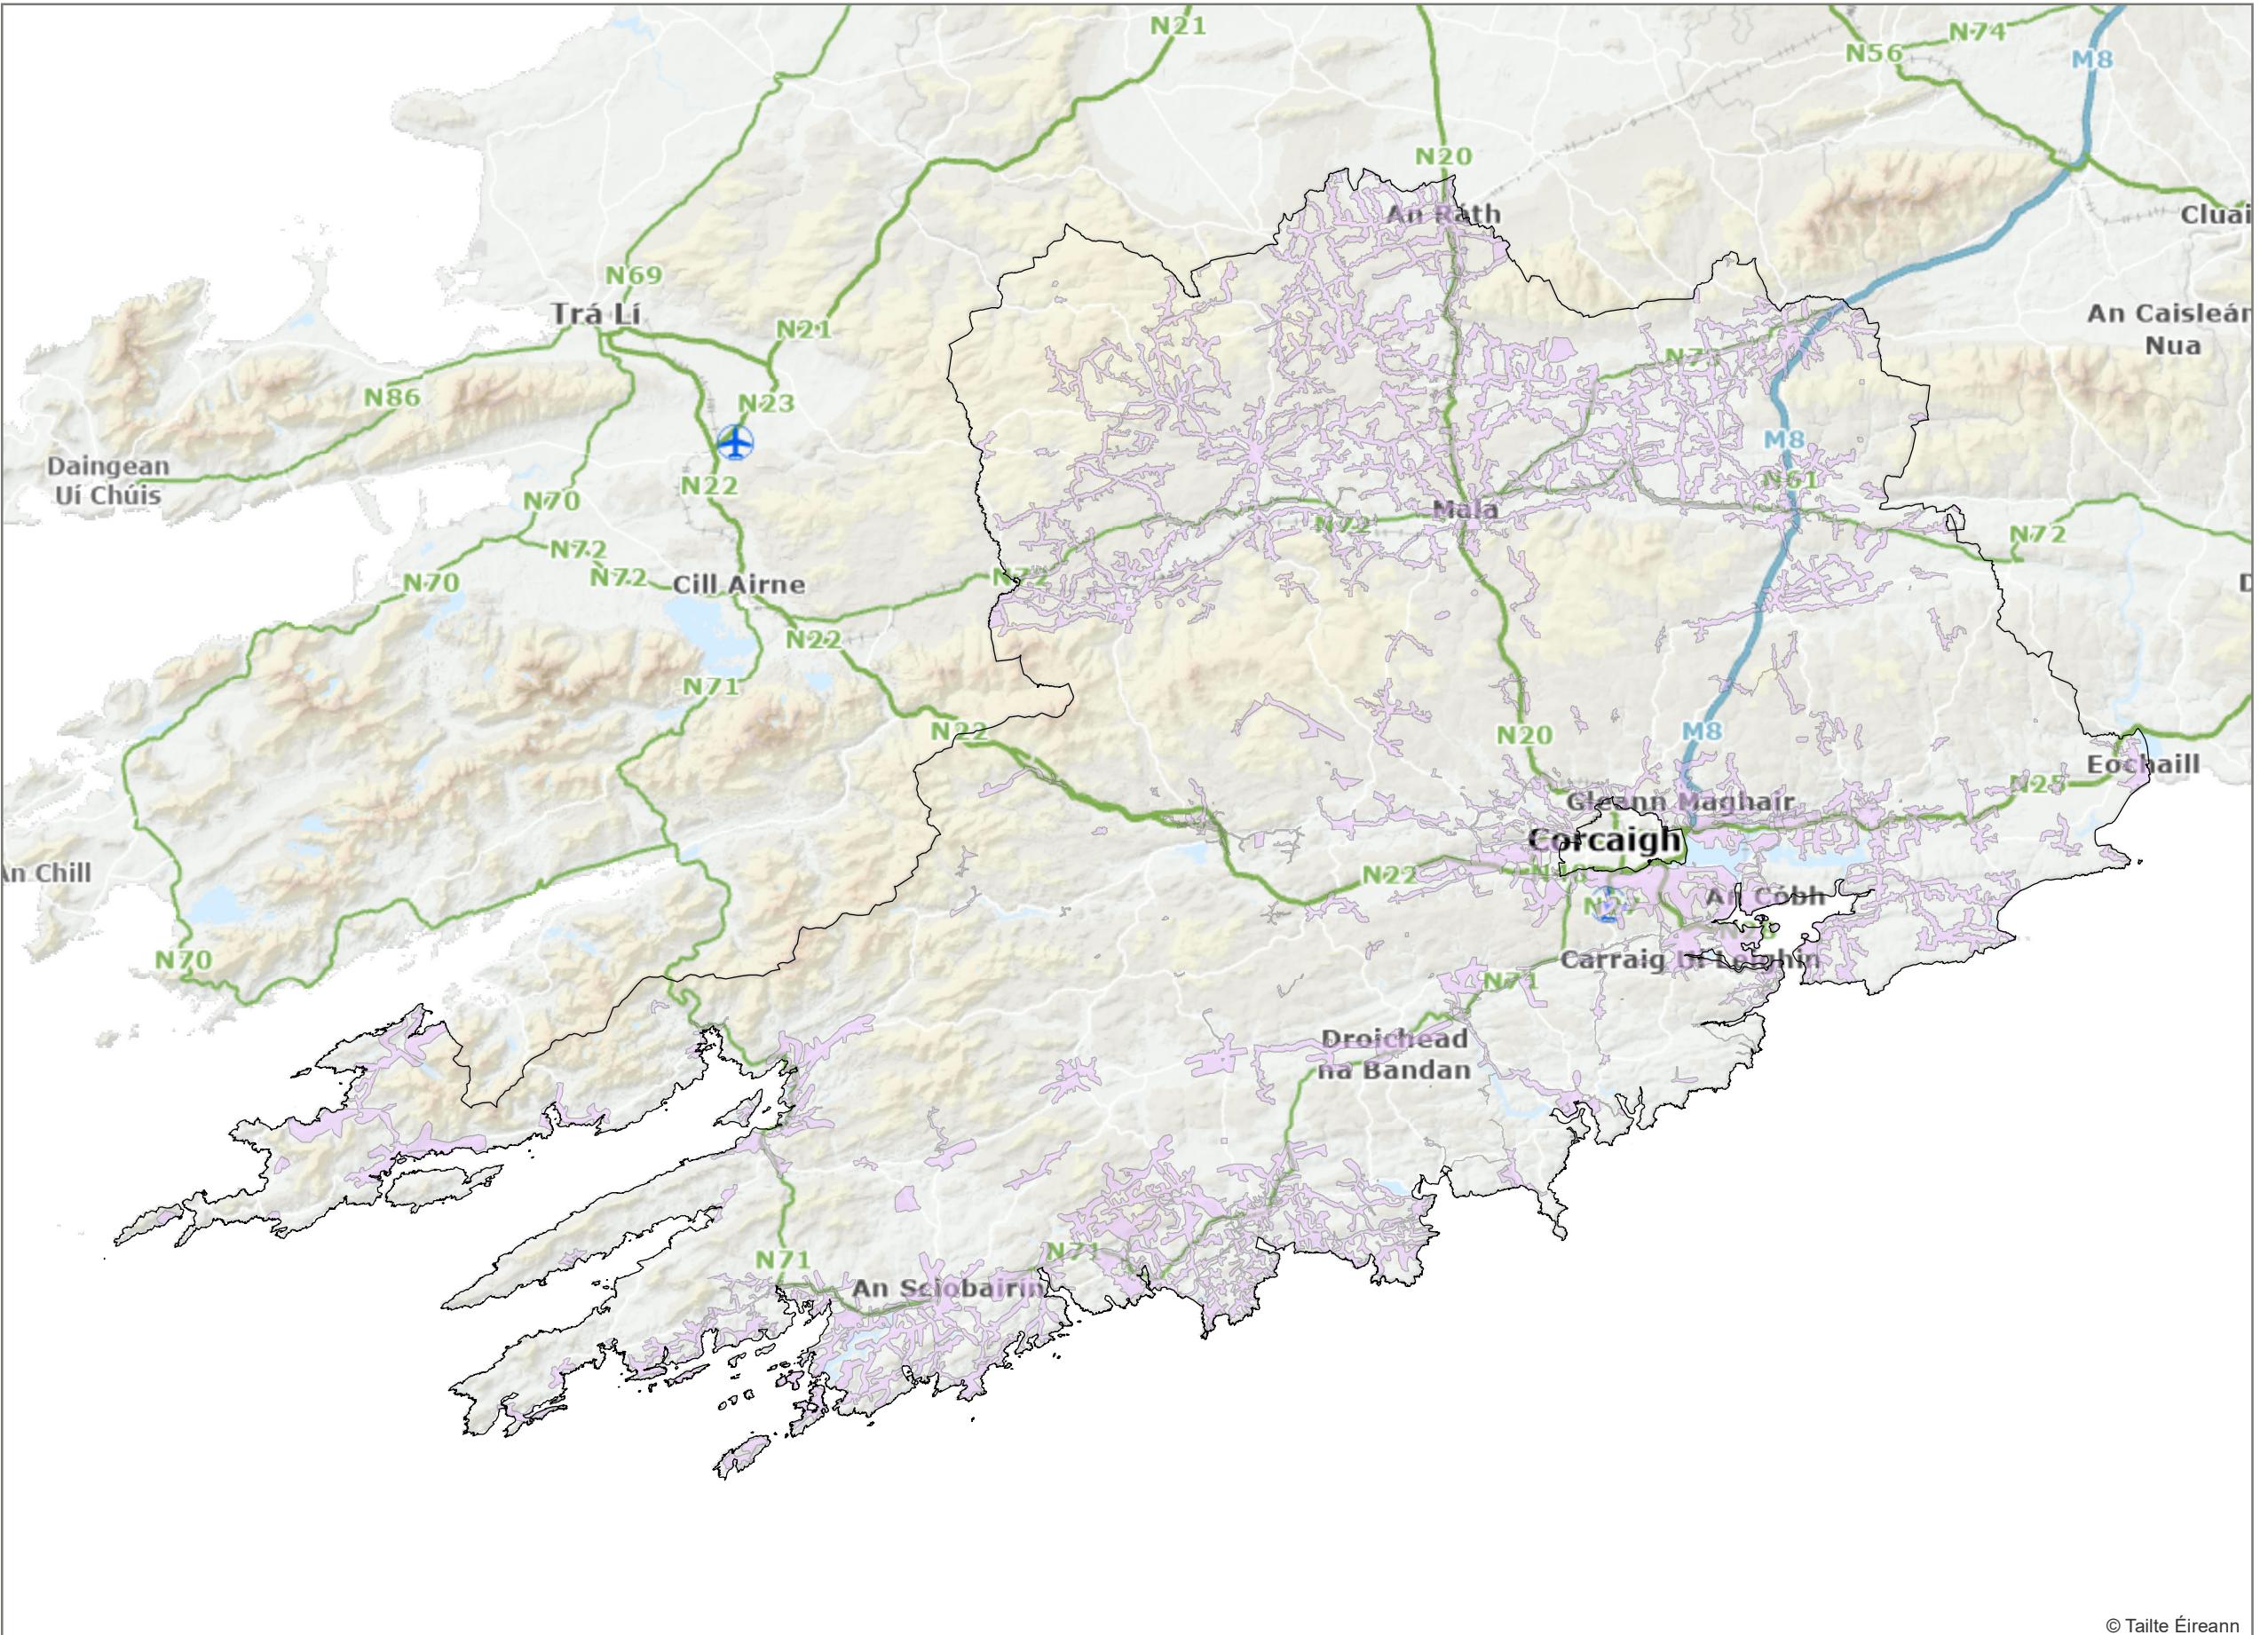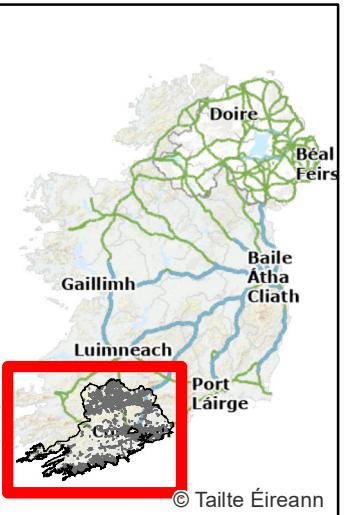

### Eochair

Corcaigh CAU

Climéadair  
01 53 6 9 12

Córas Comhordanáide:	TM65 Eangach na hÉireann
Teilgean:	Trasteilgean Mercator
Scála @ A3:	1:546,951
Dáta a terraingiodh	17/07/2025



1. Tá toirmeasc ar aon chuid den líníoch seo a aththairgeadh nó a sheoladh ar aghaidh in aon sí, nó aon chuid den líníochta a stóráil ar aon chóras aisghabhála d'aon sórt gan cead i scribhinn ó shealbhóir an chóipchirt de chuid Uisce Éireann seachas mar aontófar do dícméad a úsáid i ndáil leis an tionscadal d-a-éisíodh do dícméad chuige ar dtús.

2. Cé go ndearmadh gach uile iarracht cúram a dhéanamh ina tomsú, tugann Uisce Éireann an fhaisnéis seo i ndíil le láthair a lónra faoi thalamh mar threoir ghinearálta ar an dian-tuisceart go bhfuil an fhaisnéis bunsúil ar an eolas is fearr curtha ar fáil d'Uisce Éireann ó gach uile Údarás Áitiúil in Éirinn. Séamus Uisce Éireann freagra as crinnse, comhláine, ná ndáir chun dála na faisnéise a tugadh agus ní thabharfaidh Uisce Éireann aon ráthalochtai ná gealltanais ná barántaí maidir leis an bhfaisnéis agus séanann Uisce Éireann gach aon dileanás a d'héadadh a eascairte as aon earnáid ná as aon fhailiú ar bith. Níor cheart brath ar an bhfaisnéis seo má bhíonn tocailtú no aon oibreacha éile ar síú i gcoingear an lónra faoi thalamh de chuid Uisce Éireann. Is faoi na páirthe ag déanamh na dtocailtú ná aon oibreacha éile atá sé deimhín a dhéanamh de go sainíntheofar láthair crinn an lónra faoi thalamh de chuid Uisce Éireann suí dtabharfar faoi thusa a chur le haon tocailtú ná oibreacha éile. Ní leirithe naics sheirbhise de ghnáth ach bí ar an airdeal go bhfeadfaidís a bheith ann.

© Cóipcheart Uisce Éireann


Macasamháil déanta ó Shuirbhéarach Ordanáis na hÉireann le cead rí Rialtas. Uimh. an Cheadúnais: CYAL5037460

## Crios Acmhainní Uisce Corcaigh

**Appendix 1 to Uisce Éireann Order dated 21 July 2025**

**County Tipperary**

**The areas shown in purple are the areas to which this Order applies**

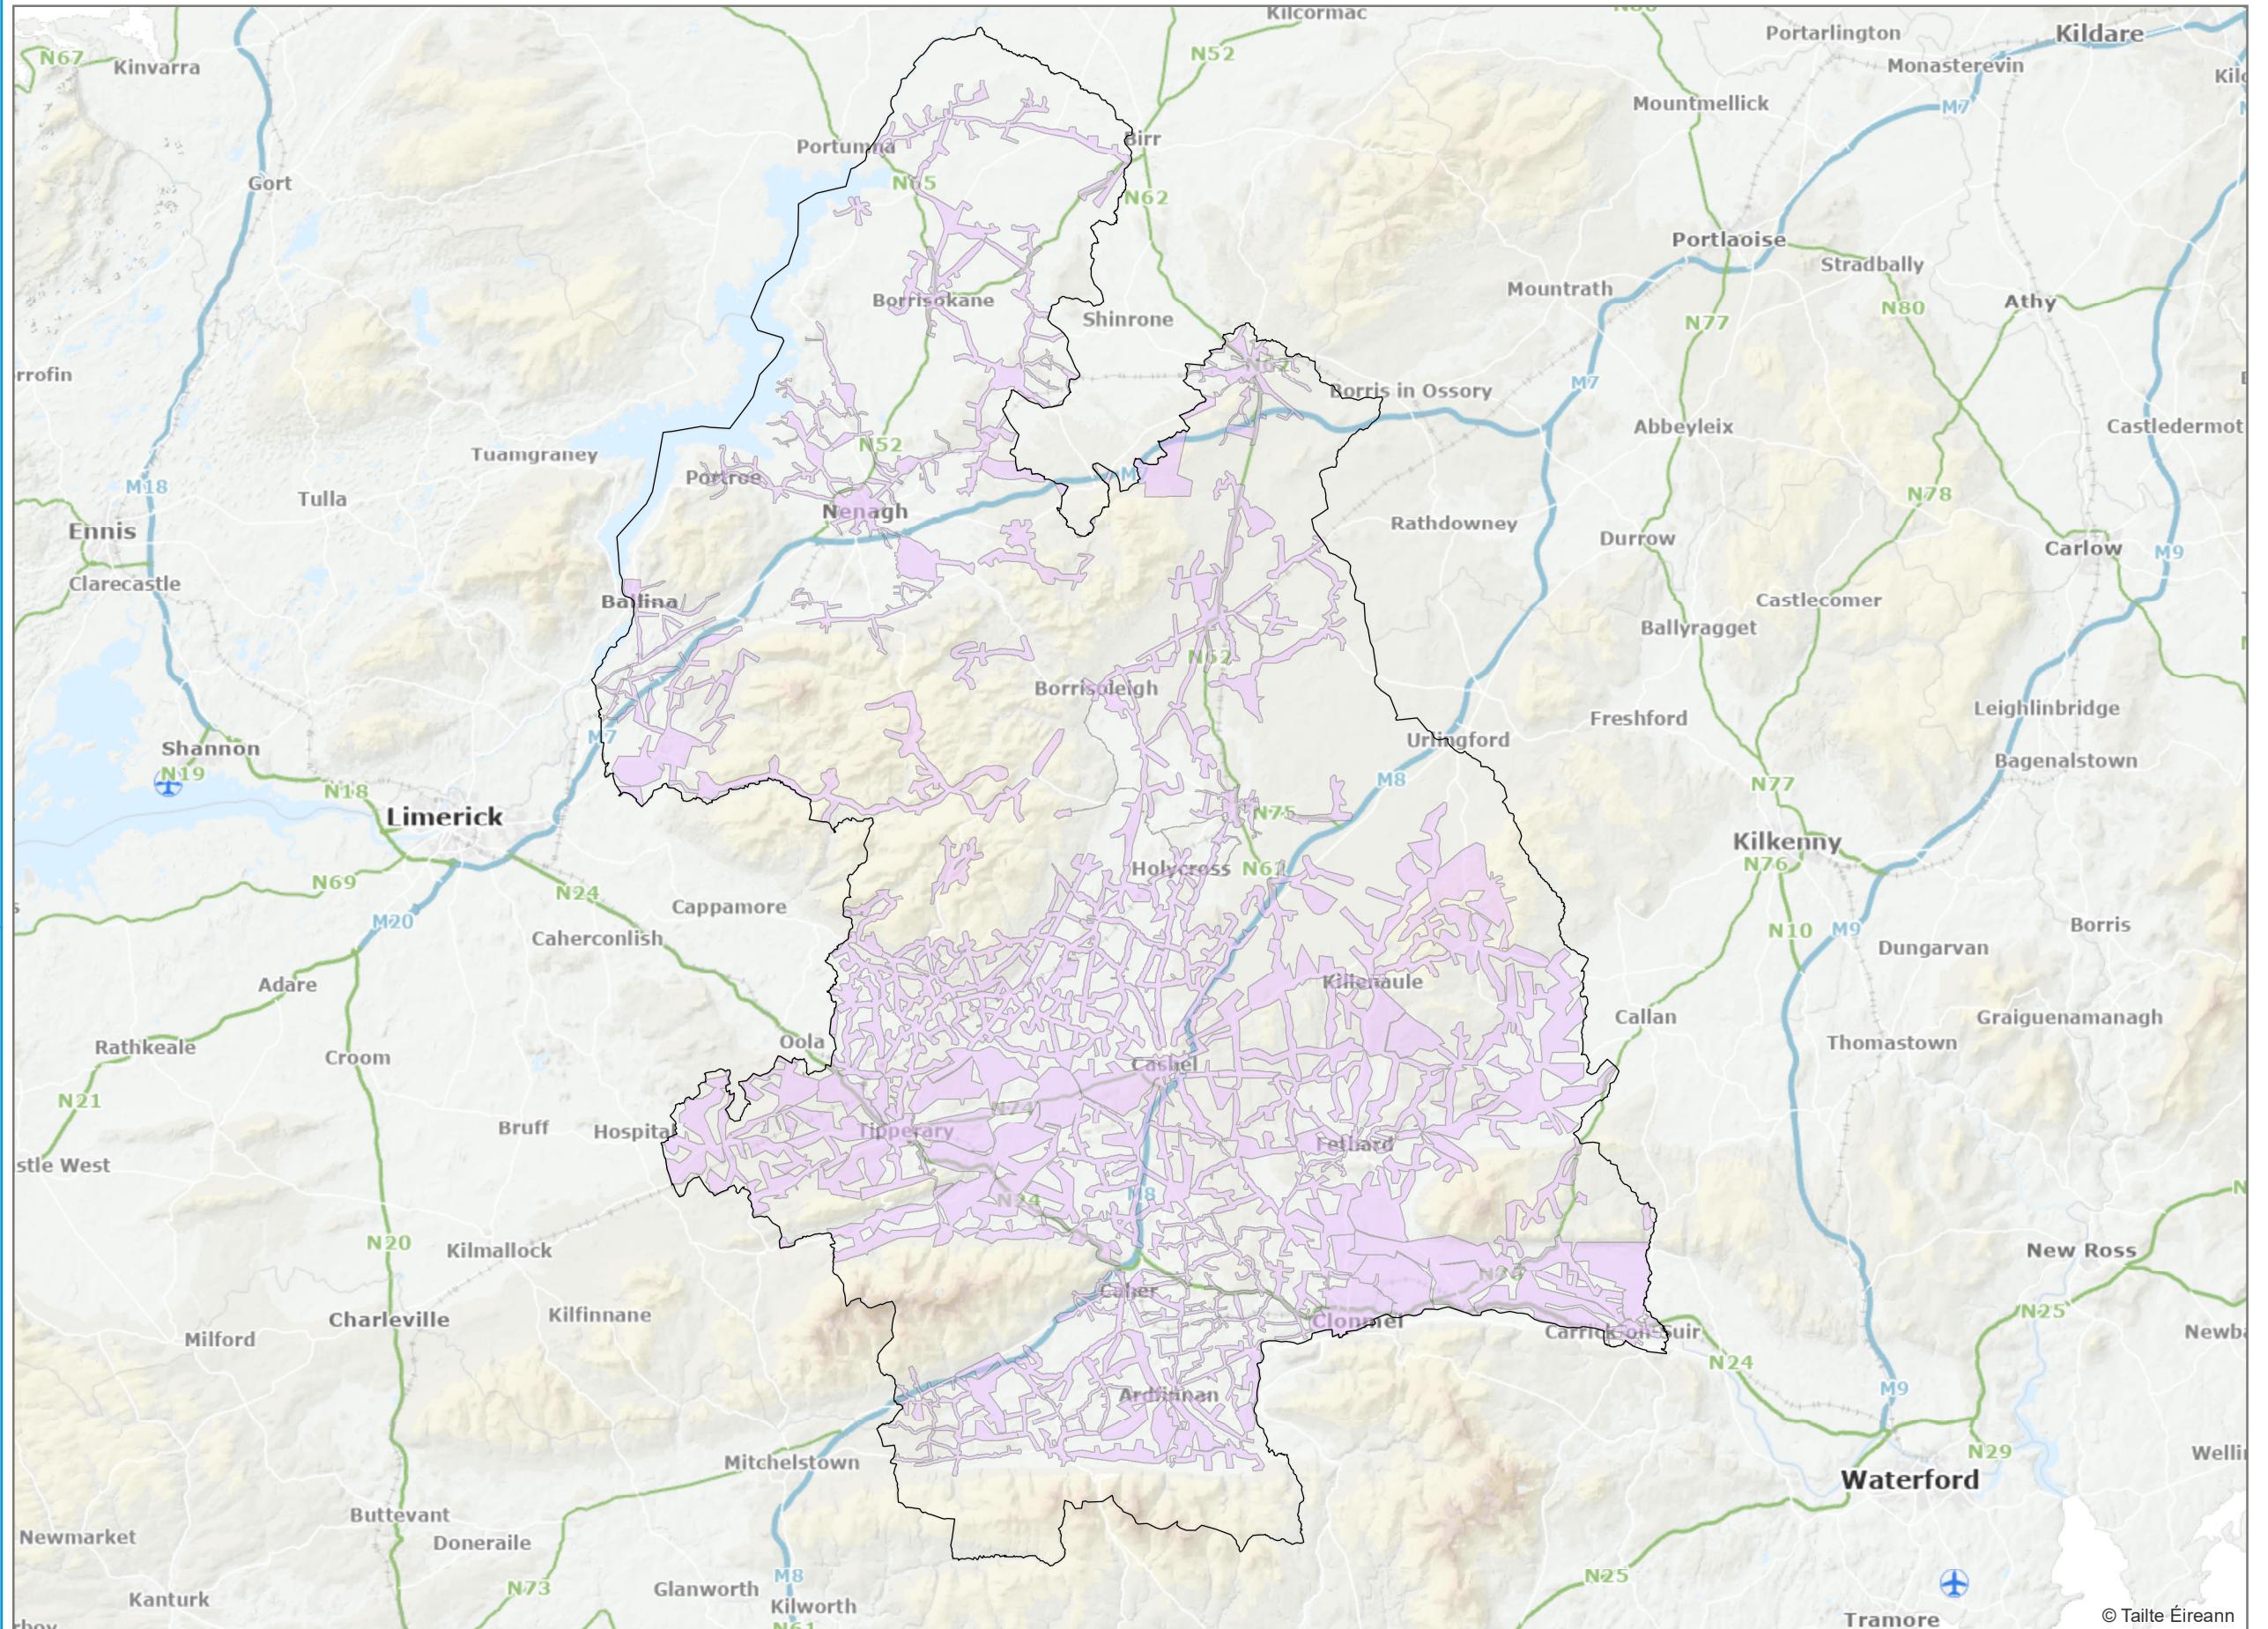

#### Legend

Tipperary WRZ

Kilometers  
0.255 5 7.510

Coordinate System: TM75 Irish Grid  
Projection: Transverse Mercator

Scale @ A3: 1:466,120

Drawn Date 16/07/2025

## Tipperary Water Resource Zones



1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Irish Water as copyright holder except as agreed for use on the project for which the document was originally issued.

2. Whilst every care has been taken in its compilation, Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Irish Water

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34



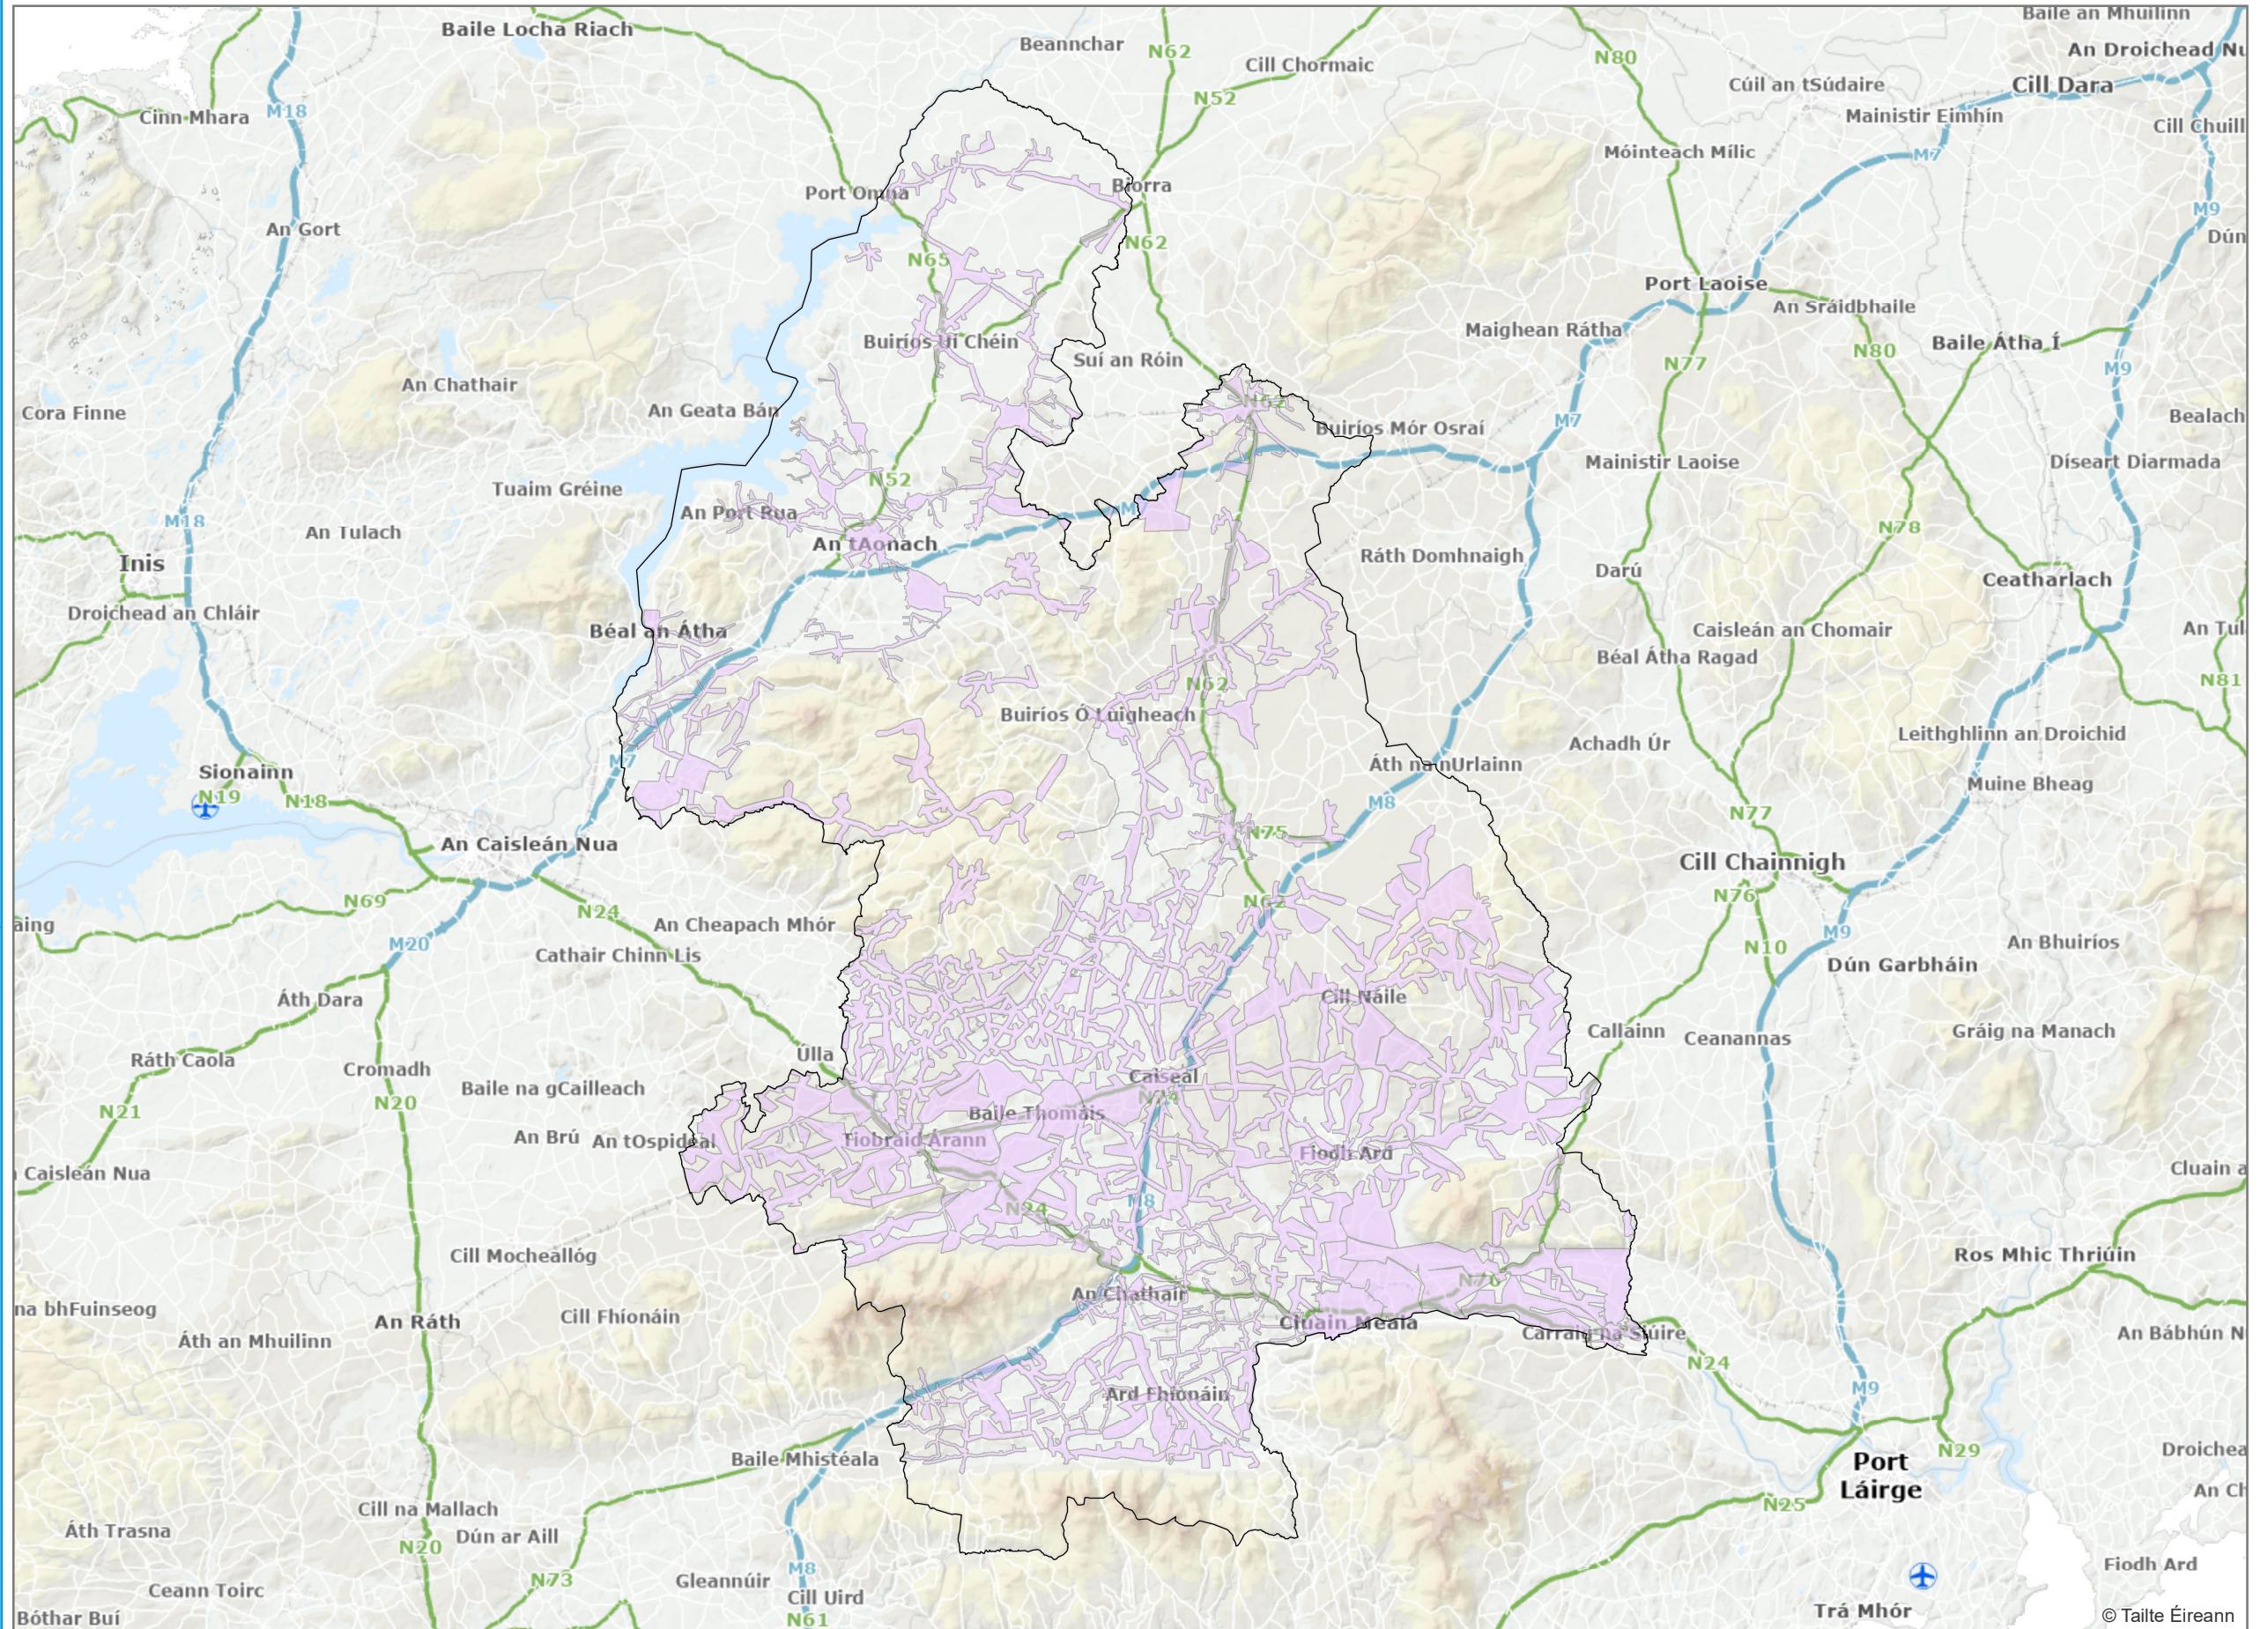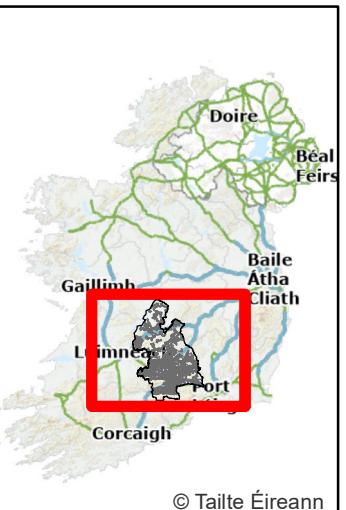

1. Tá toirmeasc ar aon chuid den líniocht seo a aththageadh nó a sheoladh ar aghaidh in aon sí, nó aon chuid den líniocht a stórlar ar aon chóras aisghabhála d'aon sórt gan cead i scribhinn ó shealbhóir an chóipchirt de chuid Uisce Éireann seachas mar aontófar an dociméad a úsáid i ndíol leis an tionscadal d-aonáisóidh an dociméad chuige ar dtús.

2. Cé go ndearmadh gach uile iarracht cúram a dhéanamh ina tomsú, tugann Uisce Éireann an fhaisnéis seo i ndíol le láthair a lónra faoi thalamh mar threoir ghinearála ar an dian-tuisceart go bhfuil an fhaisnéis bunsuitear ar an eolas is fearr curtha ar fáil d'Uisce Éireann ó gach uile Údarás Áitiúil in Éirinn. Séanann Uisce Éireann freagrais as crumhlae, comhláine, nó nádúr chun dala na faisnéise a tugadh agus ní habharfaidh Uisce Éireann aon ráthachlochtai ná geallánais ná barántail maidir leis an bhfaisnéis agus séanann Uisce Éireann gach aon dileanás a d'héadadh a eascairte as aon earráid nó as aon fhailiú ar bith. Níor cheart brath ar an bhfaisnéis seo mís bhíonn tocháil ná aon oibreacha éile ar síú i gcoingear an lónra faoi thalamh de chuid Uisce Éireann. Is faoi na páirthe ag déanamh na dtocáilí ná aon oibreacha éile atá sé deimhín a dhéanamh de go saincheolára láthair chruinn an lónra faoi thalamh de chuid Uisce Éireann suí dtabharfaí faoi thusa a chur le haon tocháil ná oibreacha éile. Ní léirtear náisc sheirbhise de ghnáth ach bí ar an airdeall go bhfeadfaidís a bheith ann.

© Cóipcheart Uisce Éireann

Mácasamháil déanta ó Shuirbhéarach Ordanáis na hÉireann le céad rí Rialtas. Uimh. an Cheadáin: CYAL50374680


## Crios Acmhainní Uisce Thiobraid Árann

Cilméadair	
0.255	5 7.5 10
Córas Comhordanáide:	
TM65 Eangach na hÉireann	
Teilgean: Trasteilgean Mercator	
Scála @ A3:	1:483,661
Dáta a terraingiodh	17/07/2025

**Appendix 2 to Uisce Éireann Order dated 21 July 2025**

**County Waterford**

**The areas shown in purple are the areas to which this Order applies**

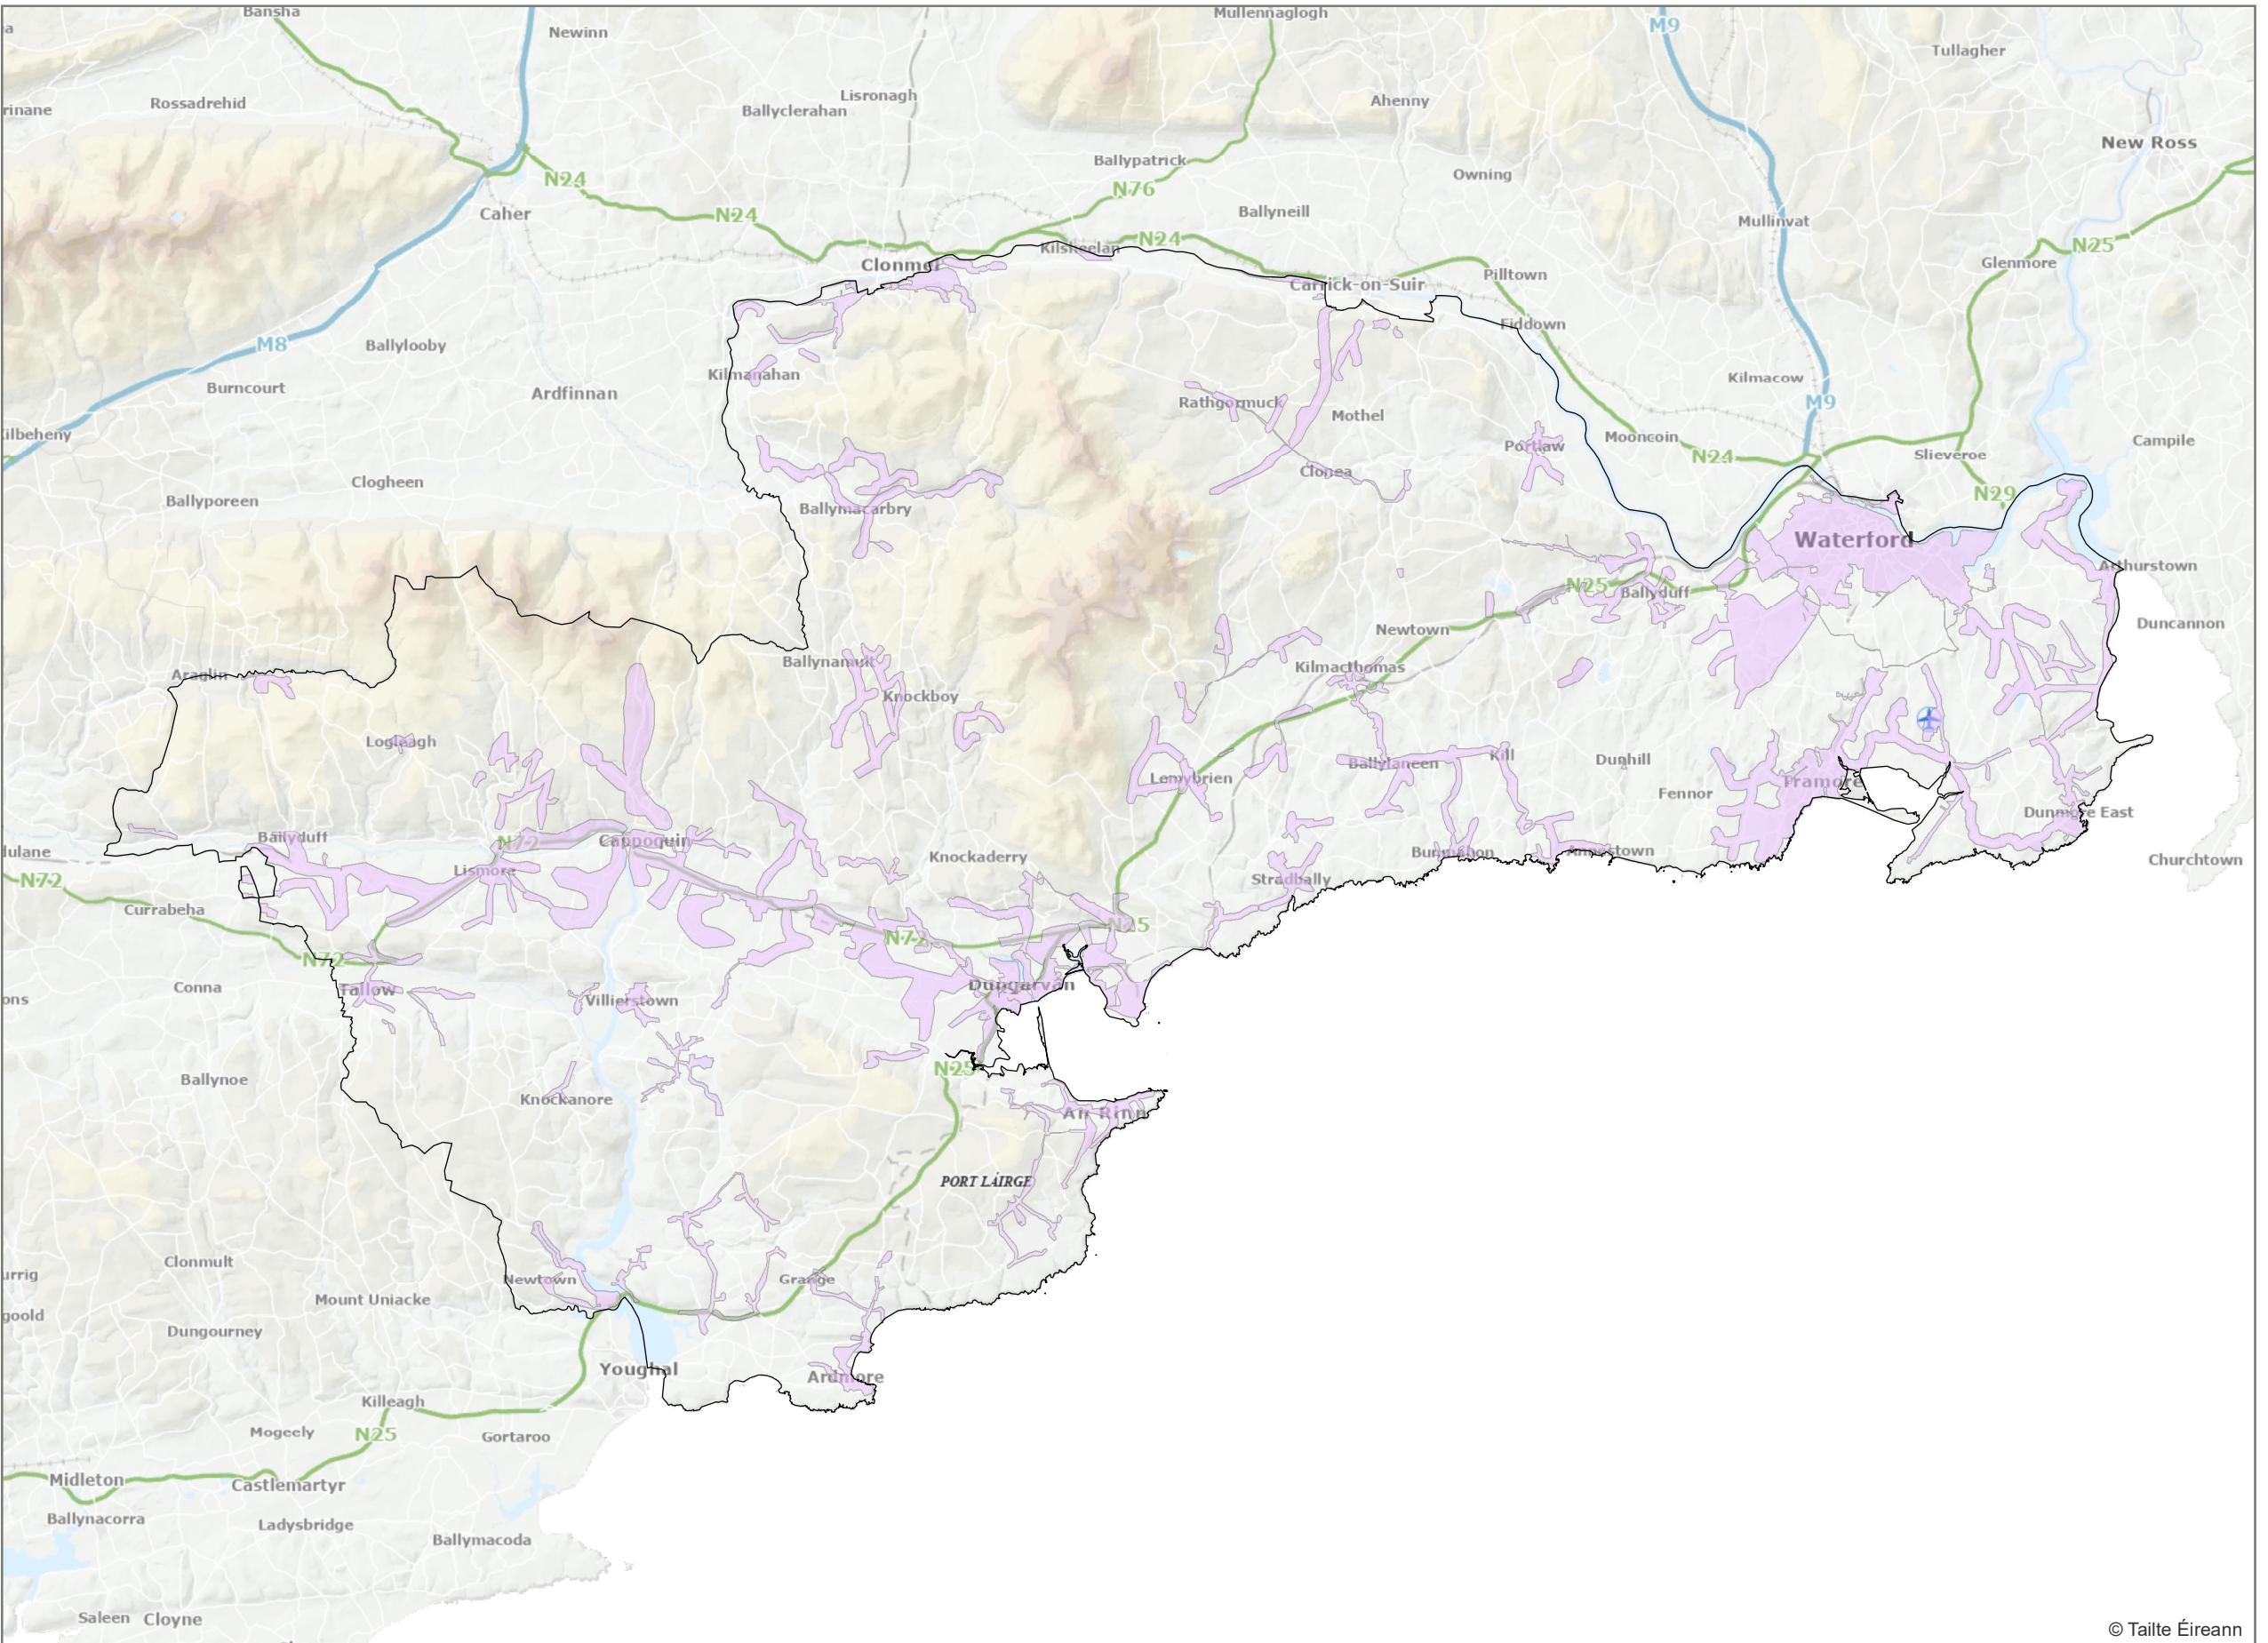

#### Legend

Waterford WRZ

Kilometers  
0.755 3 4.5 6

Coordinate System: TM65 Irish Grid  
Projection: Transverse Mercator

Scale @ A3: 1:272,035

Drawn Date 16/07/2025





1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Irish Water as copyright holder except as agreed for use on the project for which the document was originally issued.

2. Whilst every care has been taken in its compilation, Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Irish Water

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

## Waterford Water Supply Zones

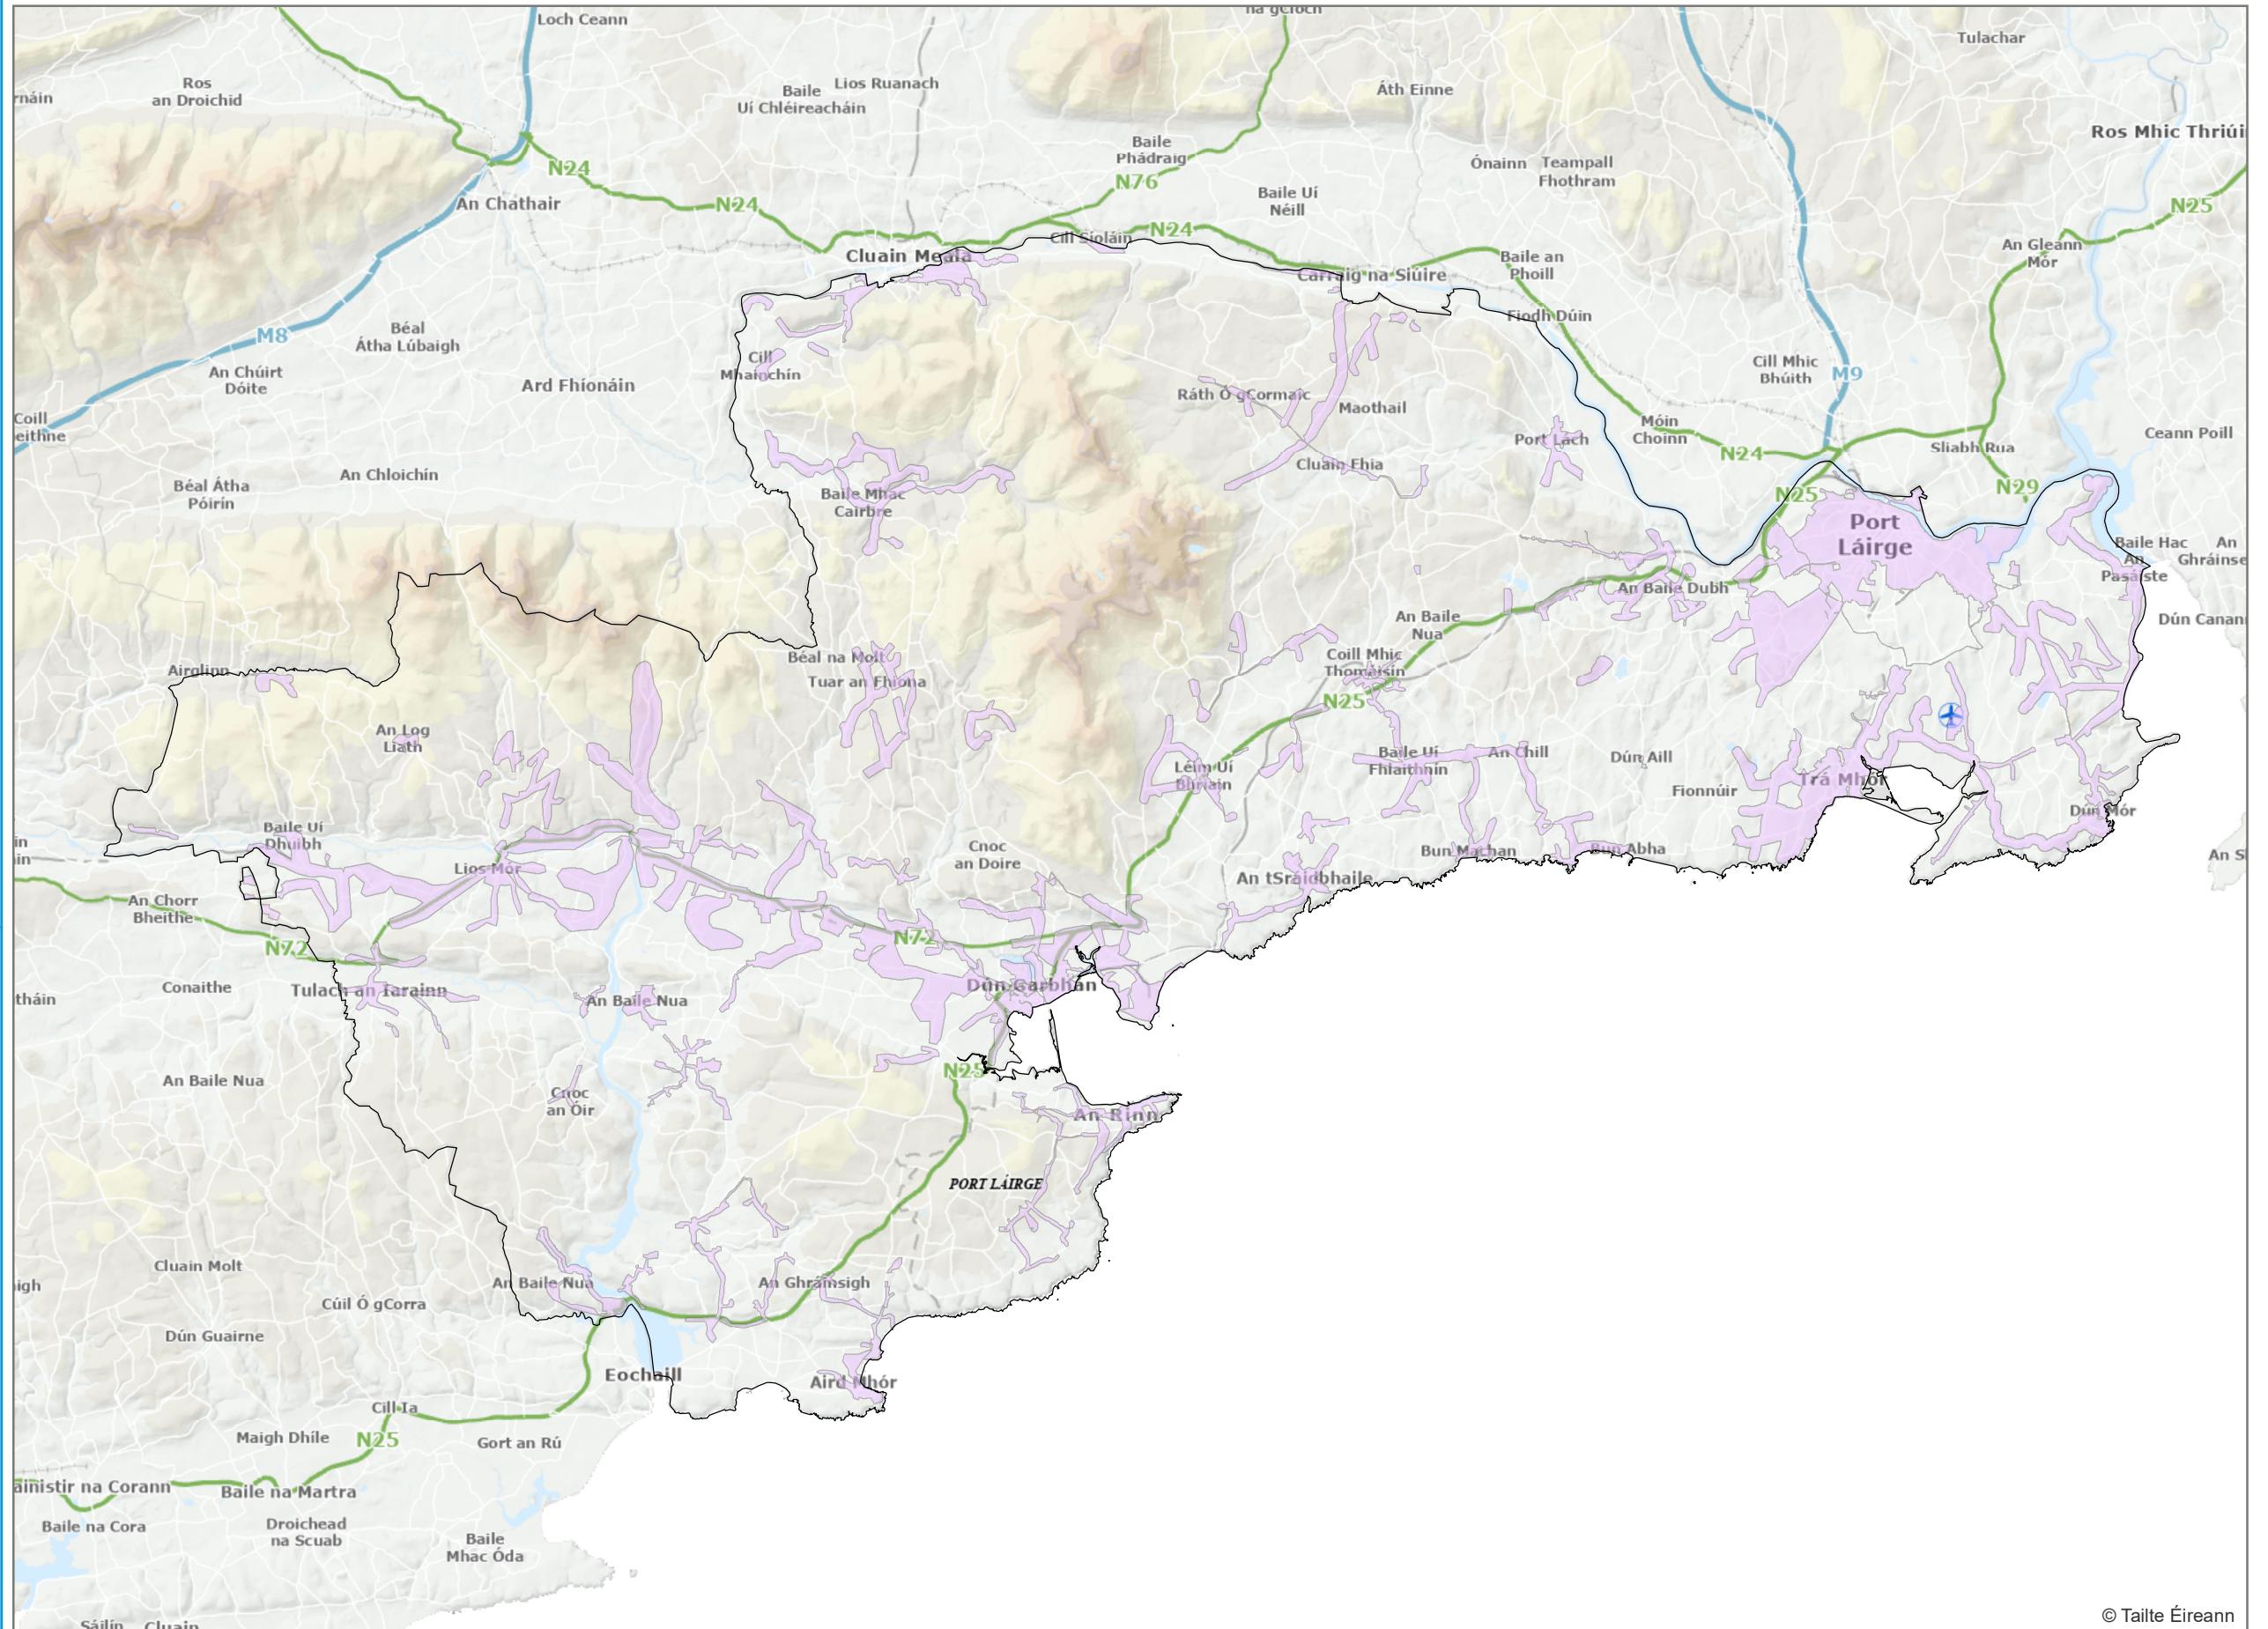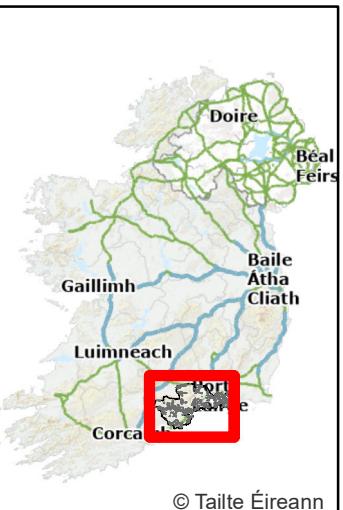

## Eochair

Port Láirge CAU

Ciliméadair					
0.755	3	4.5	6		
<b>Córas Comhordanáide:</b>					
TM65 Eangach na hÉireann					
Teilgean:Trasteilgean Mercator					
Scála @ A3:	1:266,158				
Dáta a tarraingiodh	17/07/2025				

## Crios Acmhainní Uisce Port Láirge

1. Tá toirmeasc ar aon chuid den líníoch seo a tharraingeadh nó a sheoladh ar aghaidh in aon sí, nó aon chuid den líníoch a stóráil ar aon chóras aisghabhála d'aon sórt gan cead i scribhinn ó shealbhóir an chóipchirt de chuid Uisce Éireann seachas mar aontófar an doiliméad a úsáid i ndáil leis an tionscadal d-aonáisóidh an doiliméad chugue ar dtús.

2. Cé go ndearmadh gach uile iarracht cúram a dhéanamh ina tomsú, tugann Uisce Éireann an fhaisnéis seo i ndáil le láthair a lónra faoi thalamh mar threoir ghinearártá ar an dian-tuiscean go bhfuil an fhaisnéis bunsithe ar an eolas is fear curtha ar fáil d'Uisce Éireann a gach uile Údarás Áitiúil in Éirinn. Séanann Uisce Éireann freagrais as crinnseas, comhláine, ná ndáir chun dala na faisnéise a tugadh agus ní thabharfaidh Uisce Éireann aon ráthaochtaith ná geallánaith ná barántail maidir leis an bhfaisnéis agus séanann Uisce Éireann gach aon dileanásas a d'fhéadfadh a eascairt as aon earráid nó aon fhailiú ar bith. Níor cheart brath ar an bhfaisnéis seo maidir leis an tsocháil ná oibreacha éile ar síú i gcoingar an lónra faoi thalamh de chuid Uisce Éireann. Is faoi an páirthe ag déanamh na dtocailtaithe ná aon oibreacha éile atá sé deimhín a dhéanamh de go sainiúneofar láthair chruinn an lónra faoi thalamh de chuid Uisce Éireann suí dtabharfaír faoi thus a chur le haon tocháití ná oibreacha éile. Ní léirtear náisc sheirbhise de ghnáth ach bí ar an airdeall go bhfeadfaidís a bheith ann.


© Cóipcheart Uisce Éireann

Mácasamháil déanta ó Shuirbhéarach Ordanáis na hÉireann le céad ón Ríaltas. Uimh. an Chéadúnais: CYAL50374680

**Appendix 3 to Uisce Éireann Order dated 21 July 2025**

**County Wexford**

**The areas shown in purple are the areas to which this Order applies**

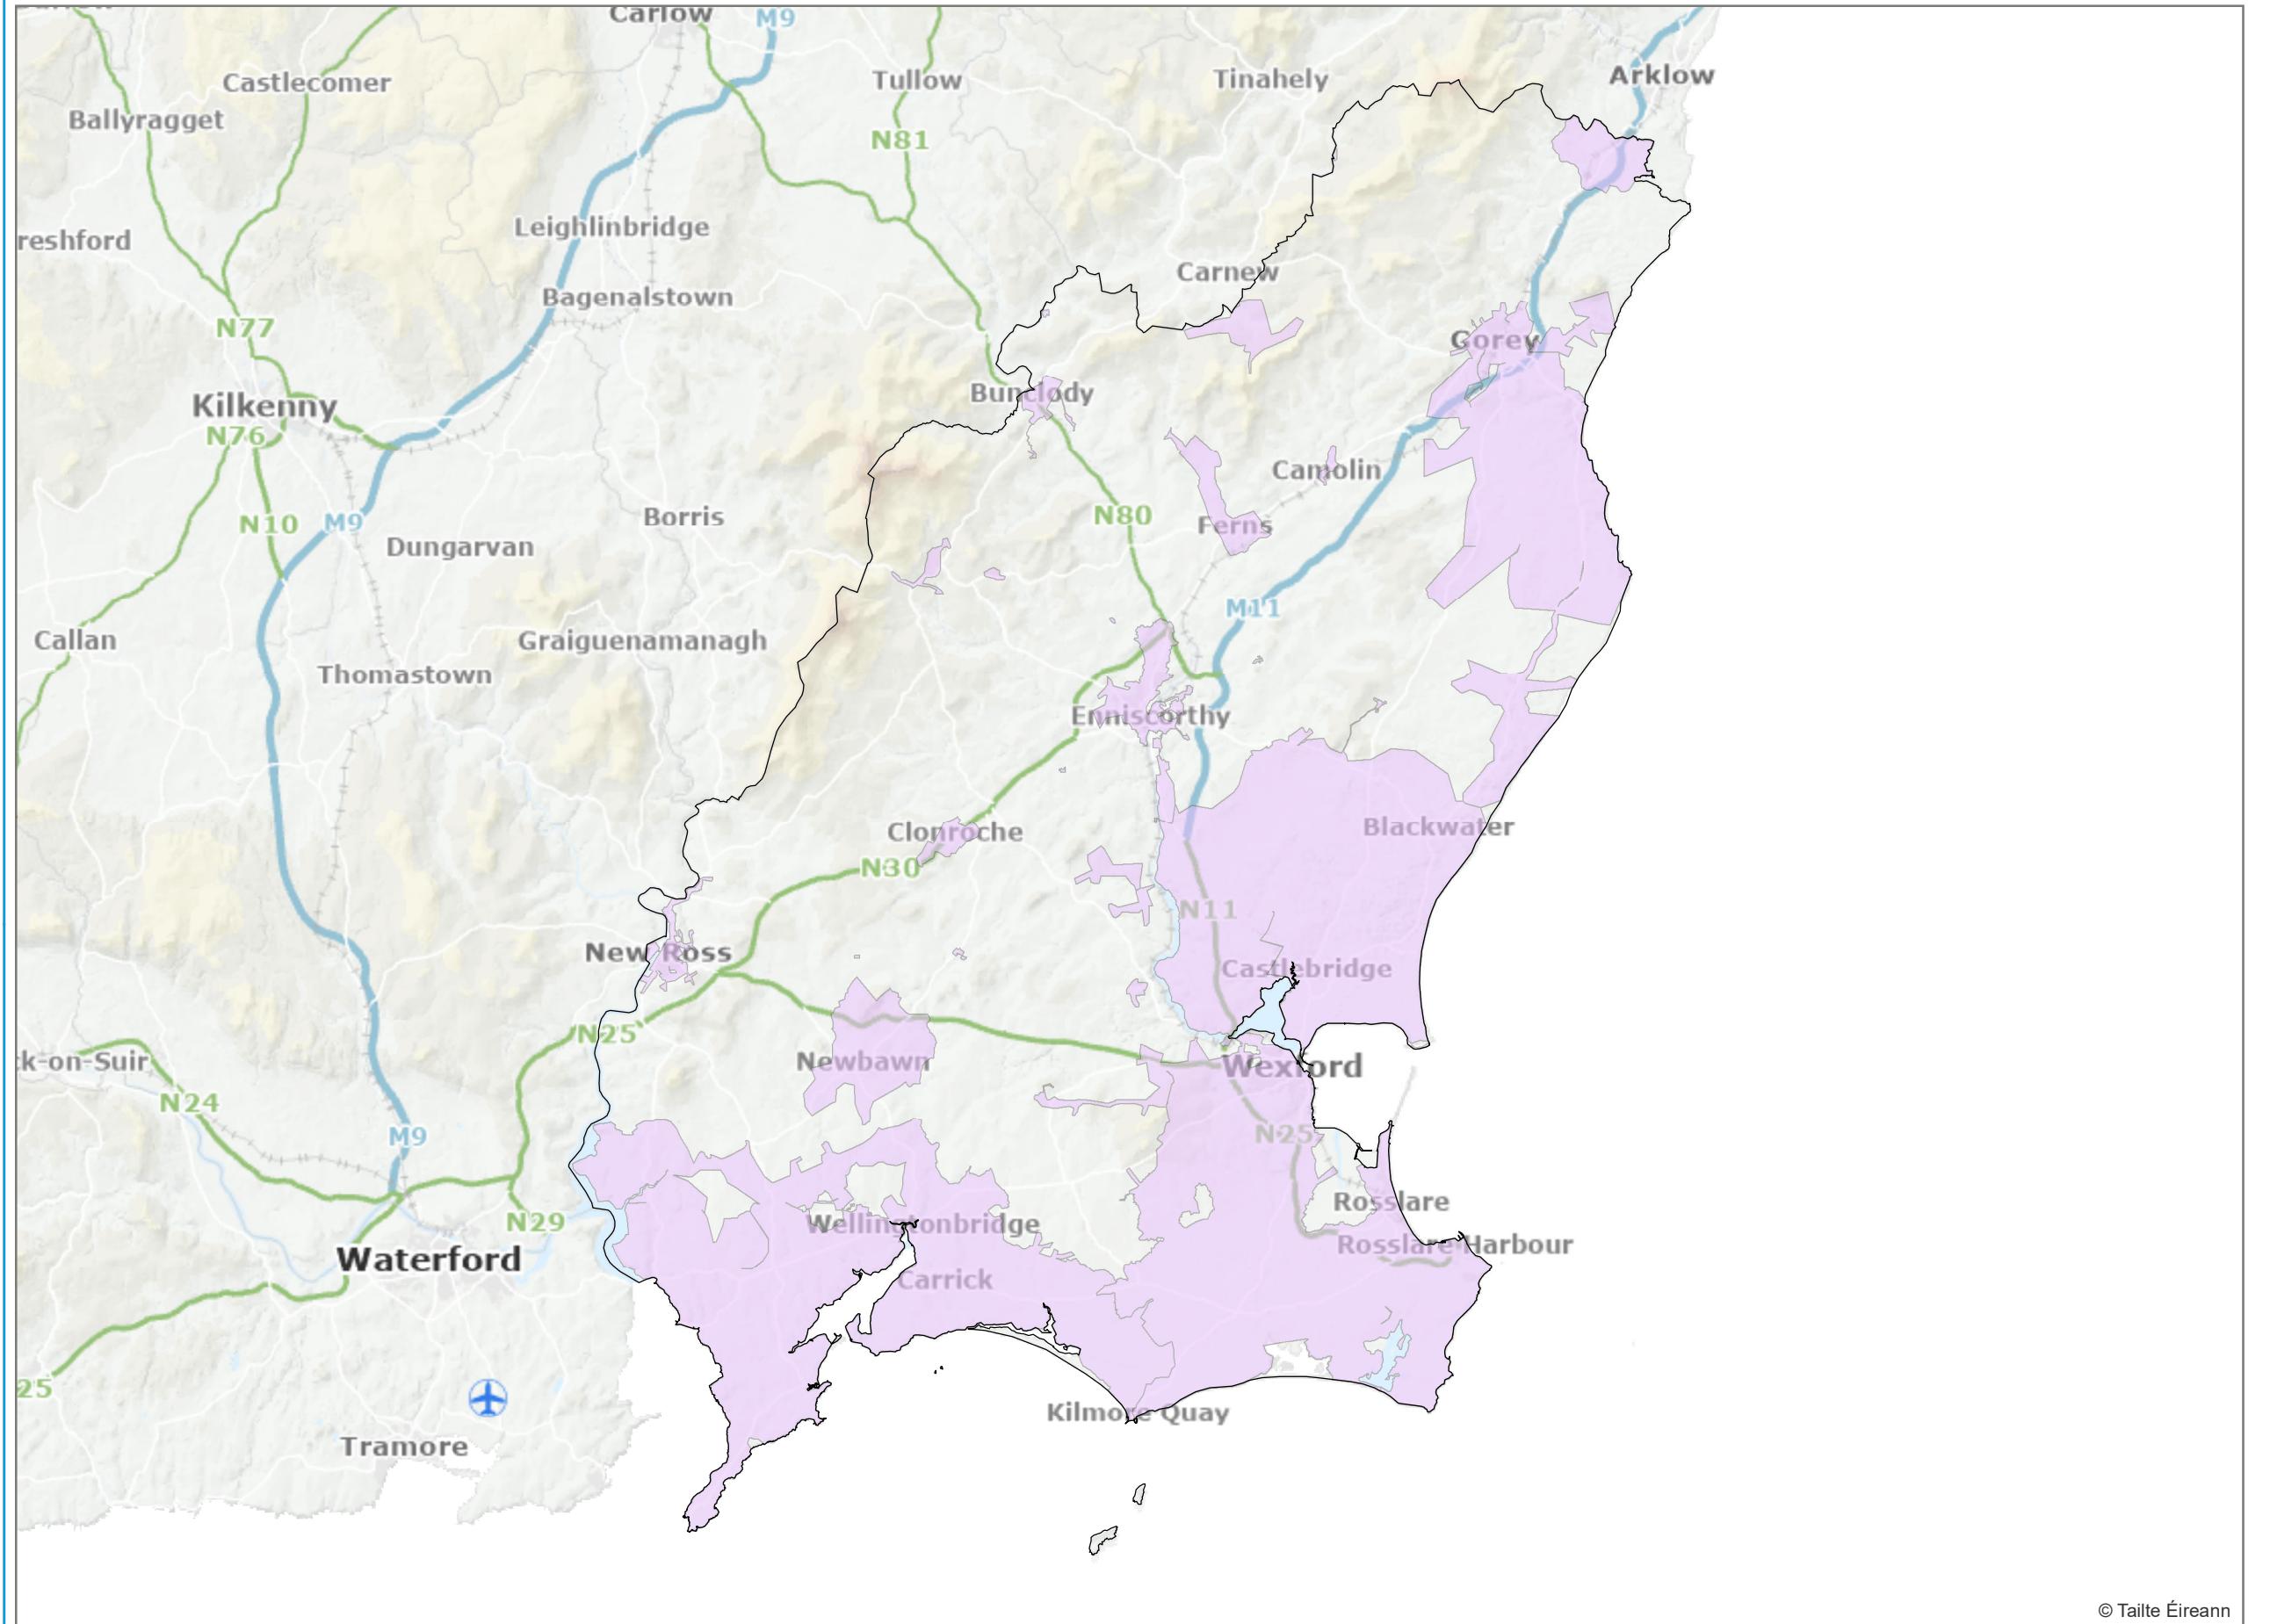

#### Legend

Wexford WRZ

Kilometers  
0 1 2 4 6 8

Coordinate System: TM65 Irish Grid  
Projection: Transverse Mercator

Scale @ A3: 1:347,348

Drawn Date 16/07/2025



1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Irish Water as copyright holder except as agreed for use on the project for which the document was originally issued.

2. Whilst every care has been taken in its compilation, Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Irish Water

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

## Wexford Water Resource Zones



Eochair

Loch Garman CAU

Cilméadair  
0 1 2 4 6 8

Córas Comhordanáide:  
TM65 Eangach na hÉireann  
Teilgean:Trasteilgean Mercator

Scála @ A3: 1:332,809

Dáta a terraingiodh 17/07/2025



1. Tá toirmeasc ar aon chuid den líniocht seo a aththairgeadh nó a sheoladh ar aghaidh in aon sí, nó aon chuid den líniocht a stórlar ar aon chóras aisghabhála d'aon sórt gan cead i scribhinn ó shealbhóir an chóipchirt de chuid Uisce Éireann seachas mar aontófar an doiciméad a úsáid i ndáil leis an foinscadal d-aonrobhach an doiciméad chuige ar dtús.

2. Cé go ndearmadh gach uile iarracht cúram a dhéanamh ina toimseú, tugann Uisce Éireann an fhaisnéis seo i ndáil le láthair a lónra faoi thalamh mar threoir ghinearálta ar an dian-tuisceart go bhfuil an fhaisnéis bunsithe ar an eolas is fear curtha ar fáil d'Uisce Éireann ó gach uile Udarás Áitiúil in Éirinn. Seánán Uisce Éireann freagairt as crínnies, comhláine, ná ndáir chun dála na faisnéise a tugadh agus ní habharfaidh Uisce Éireann aon ráthalochtaithe ná gealltanais ná barántaí maidir leis an bhfaisnéis agus séanán Uisce Éireann gach aon dileanás a d'fhéadfadh a eascairt as aon earnáidi nó as aon fhailiú ar bith. Níor cheart brath ar an bhfaisnéis seo maidir tochailtú ná aon oibreacha éile ar síú i gcoingear an lónra faoi thalamh de chuid Uisce Éireann. Is faoi na páirthe ag déanamh na dtocailtú ná aon oibreacha éile atá sé deimhín a dhéanamh de go saincheandóir láthair crínn an lónra faoi thalamh de chuid Uisce Éireann suí dtabharfaír faoi thusa a chur le haon tochailt ná oibreacha éile. Ní leirithe na scála sheirbhise de ghnáth ach bí ar an airdeall go bhfeadfaidís a bheith ann.

© Cóipcheart Uisce Éireann

Mácasamháil déanta ó Shuirbhéarach Ordanáis na hÉireann le céad ón Rialtas. Uimh. an Cheadúnaí: CYAL5037460

## Crios Acmhainní Uisce Loch Garman